


MOUNTING BASE DETAIL

ELECTRICAL CHARACTERISTICS IN ACCORDANCE WITH ANSI C29.11-1988	
DRY 60 HZ FLASHOVER	505
WET 60 HZ FLASHOVER	450
IMPULSE POSITIVE FLASHOVER	790
IMPULSE NEGATIVE FLASHOVER	825

ELECTRICAL CHARACTERISTICS IN ACCORDANCE WITH IEC-60383	
WET 60 HZ 1-MIN WITHSTAND	335
IMPULSE POSITIVE WITHSTAND	710
IMPULSE NEGATIVE WITHSTAND	740

MAX WORKING LOADS, LBS(KN)	
VERTICAL	10000 (44.4)
TRANSVERSE TENSION	7500 (33.3)
COMPRESSION	7500 (33.3)
LONGITUDINAL	1355 (6)
LEAKAGE DISTANCE	137
STRIKE DISTANCE	51.7

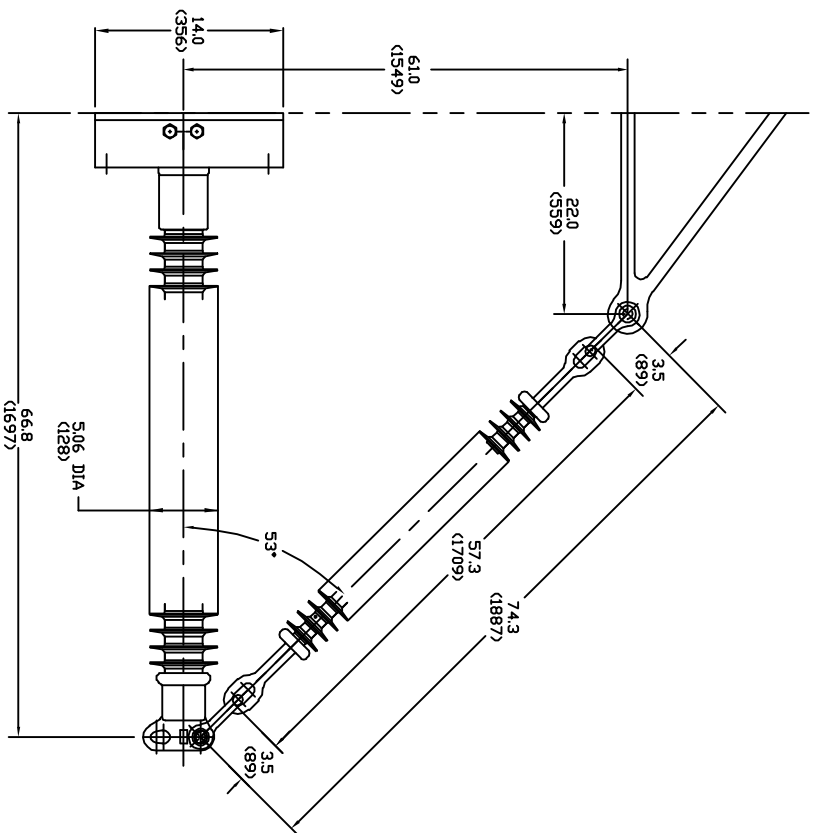

Post	P250053S0430	1
Suspension	S0250053S0000	1
Anchor Shackle	AS-50	2
Part Number	Qty	

REV DATE 03/31/08

CONFIDENTIAL: THIS DRAWING AND ITS CONTENTS ARE CONFIDENTIAL AND THE PROPERTY OF HUBBELL POWER SYSTEMS. NO REPRODUCTION OR DISTRIBUTION OF THIS DRAWING OR ITS CONTENTS IS PERMITTED WITHOUT THE WRITTEN CONSENT OF HUBBELL POWER SYSTEMS. UNPUBLISHED HUBBELL POWER SYSTEMS. ALL RIGHTS RESERVED UNDER THE COPYRIGHT LAWS.

HUBBELL POWER SYSTEMS

QUADRI SIL BRACED LINE POST ASSY

SIZE: 10000 (44.4)

DATE: 03/31/08

DESIGNER: JVR

CHECKED: JVR

DATE: 03/31/08

SHEET 1 OF 1