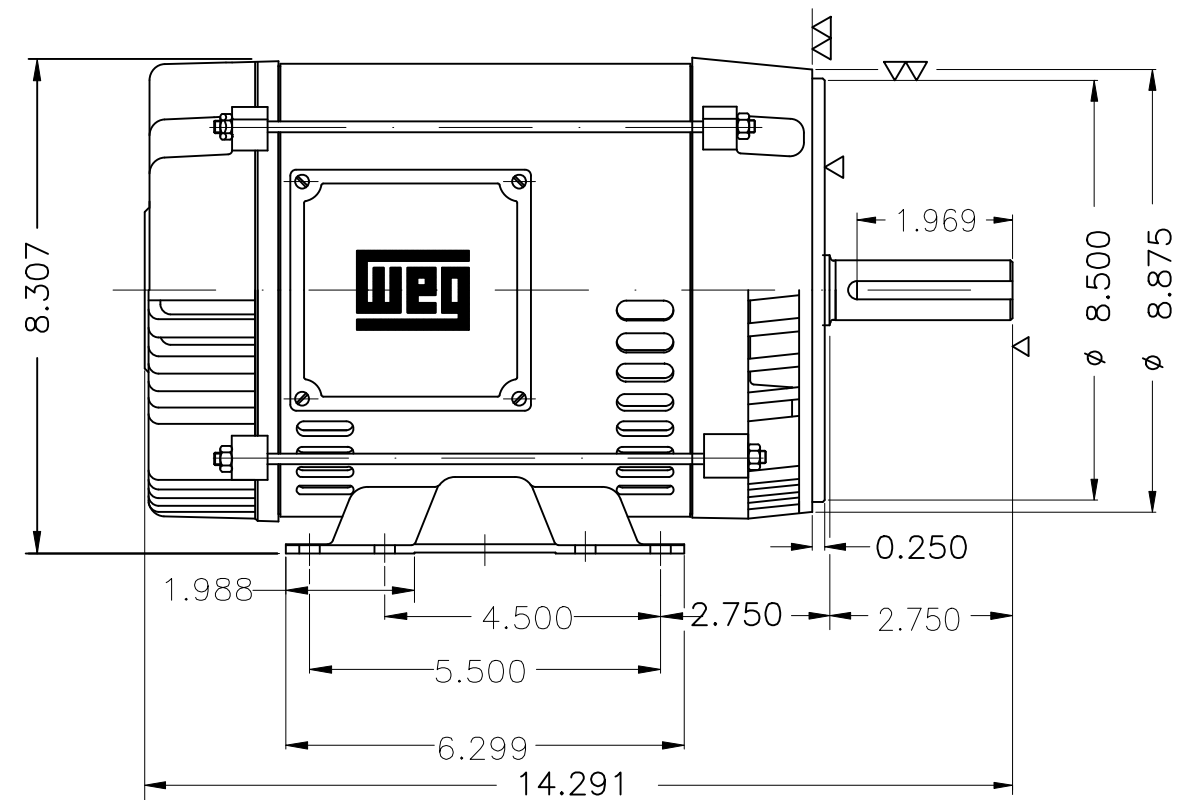


5 HP 04 Poles 60 Hz							A
		HYBRISUSER					00
ECM	LOC	SUMMARY OF MODIFICATIONS		EXECUTED	CHECKED	RELEASED	DATE VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR GENERAL NEMA PREM. EFF. FRAME 184TC IP21 ODP		PREVIEW WDD 00		
CHECKED							
RELEASED							
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1	