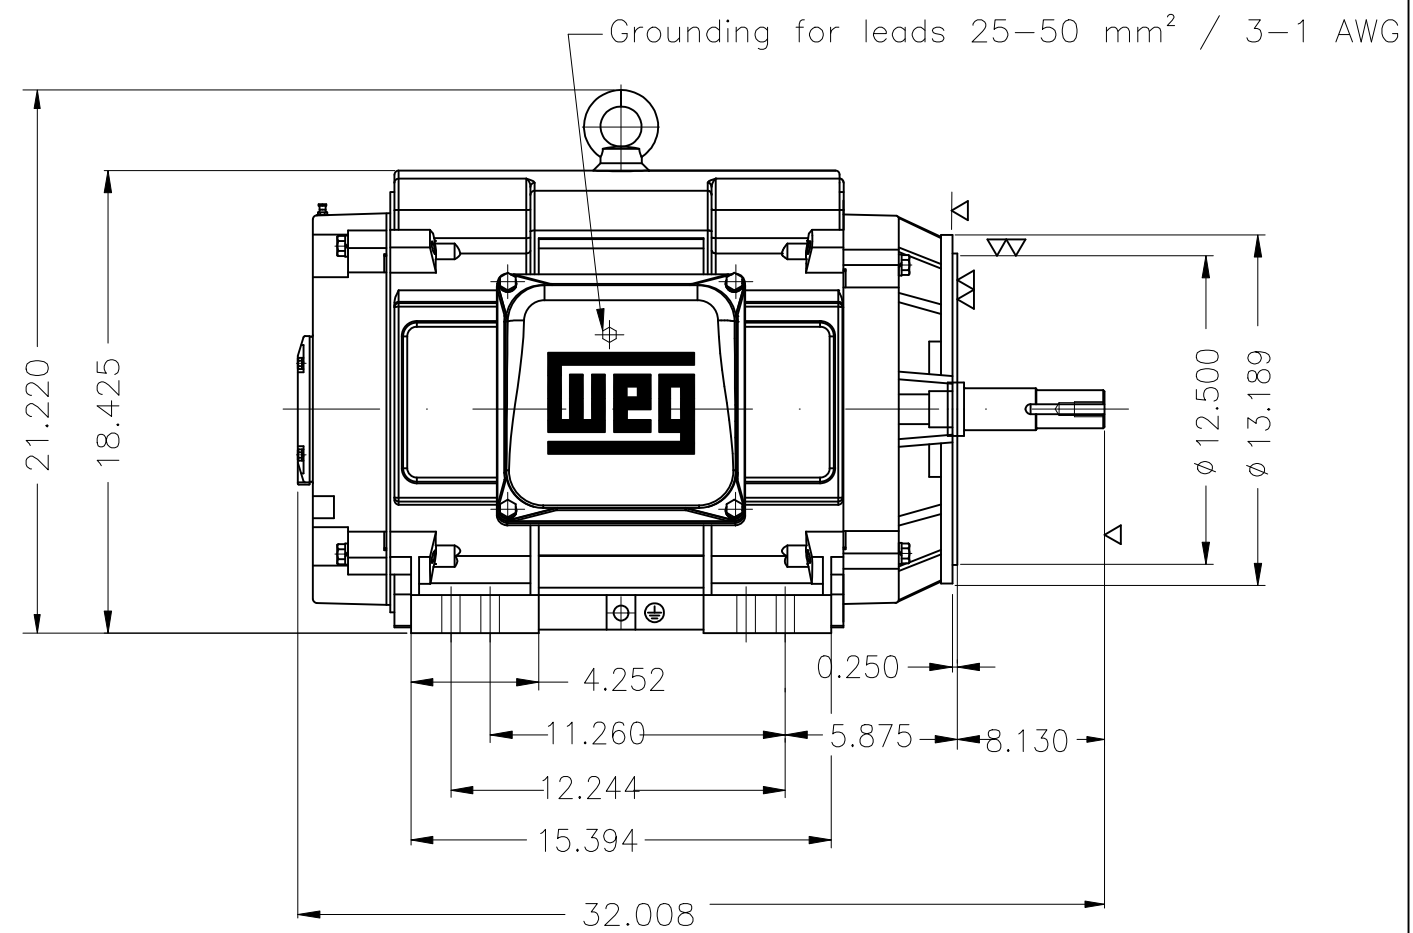
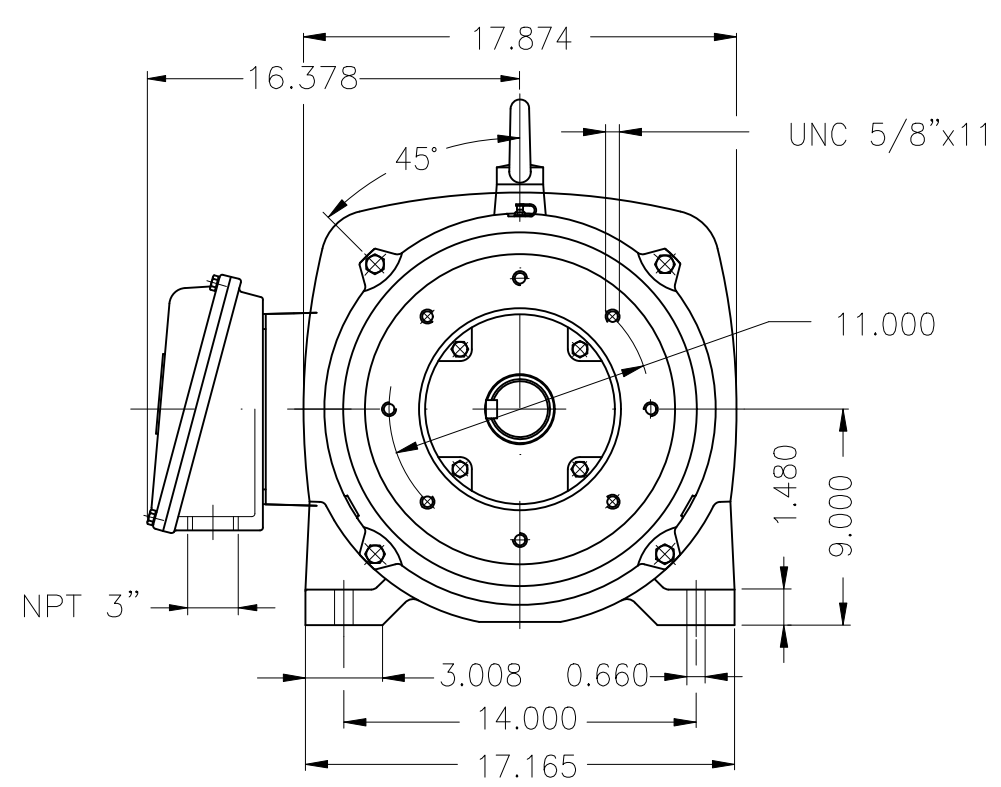



60 HP 04 Poles 60 Hz										A
					HYBRISUSER					00
ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER	
EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP NEMA PREM. EFF.			PREVIEW				
CHECKED			FRAME 364/5JP IP23 ODP							
RELEASED										
REL. DATE			WMO Jaragua do Sul Product Engineering			SHEET 1 / 1				