
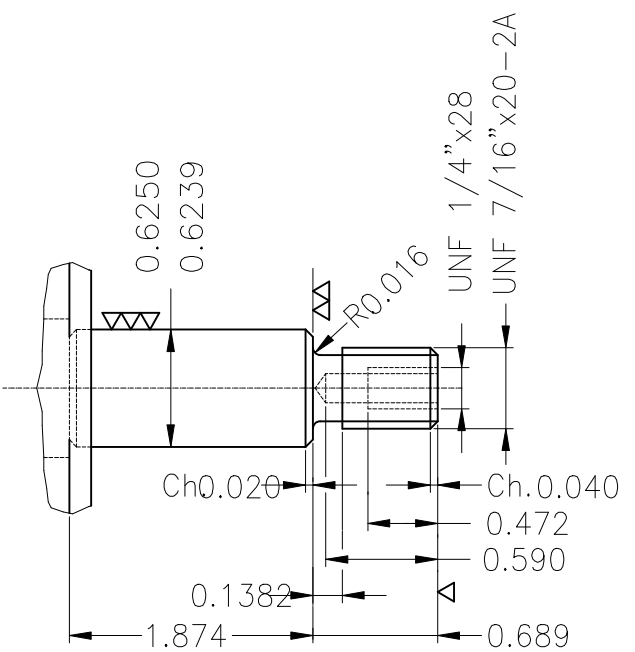
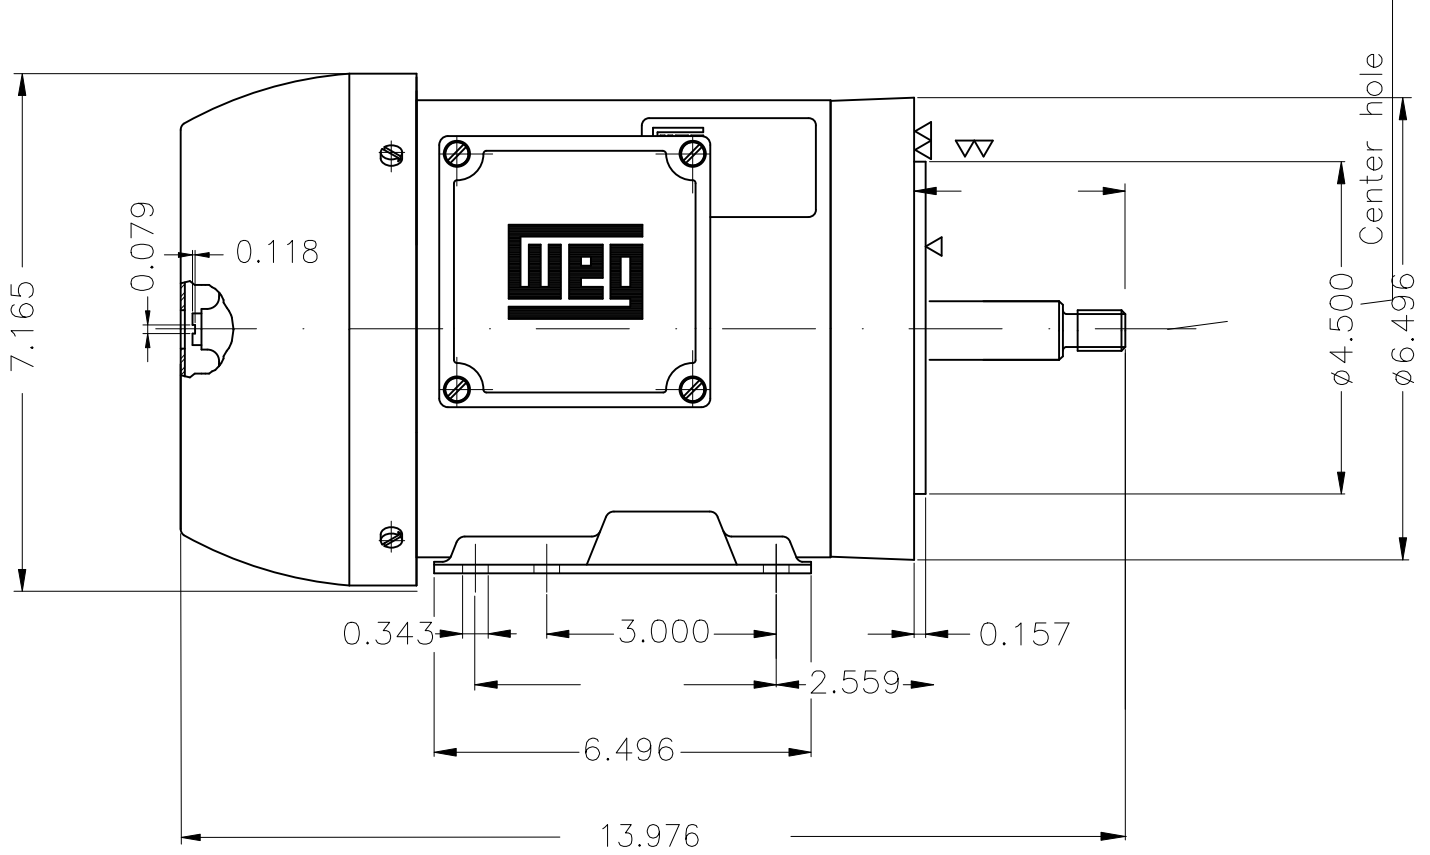


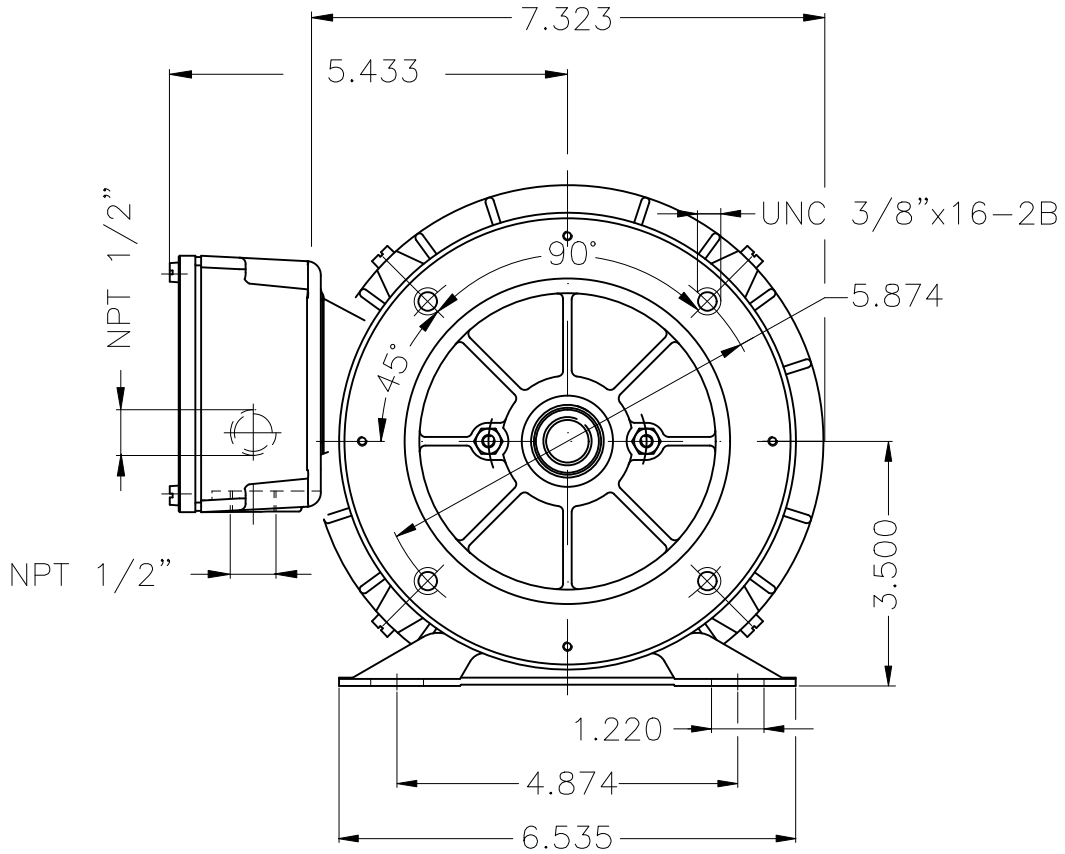

Mounting B34R(D)									
				HYBRISUSER					00
ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	 	THREE PH. MOTOR CENTRIFUGAL PUMP FRAME F56HJ IP55 TEFC			PREVIEW			
CHECKED						WDD	00		
RELEASED									
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1	/		

3 HP 02 Poles 60 Hz

A