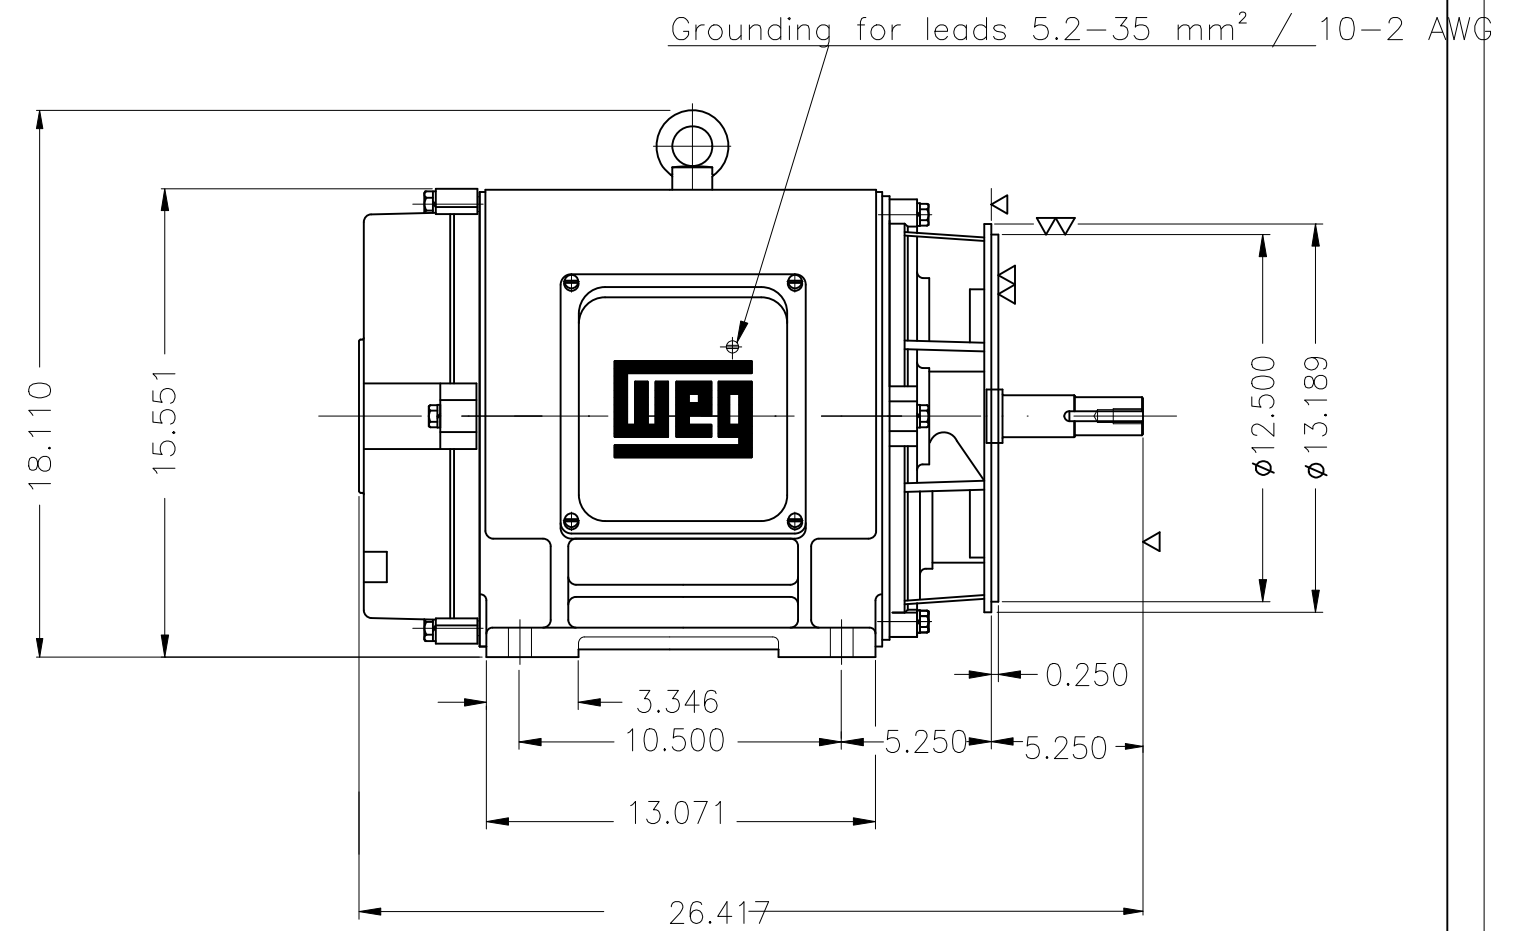
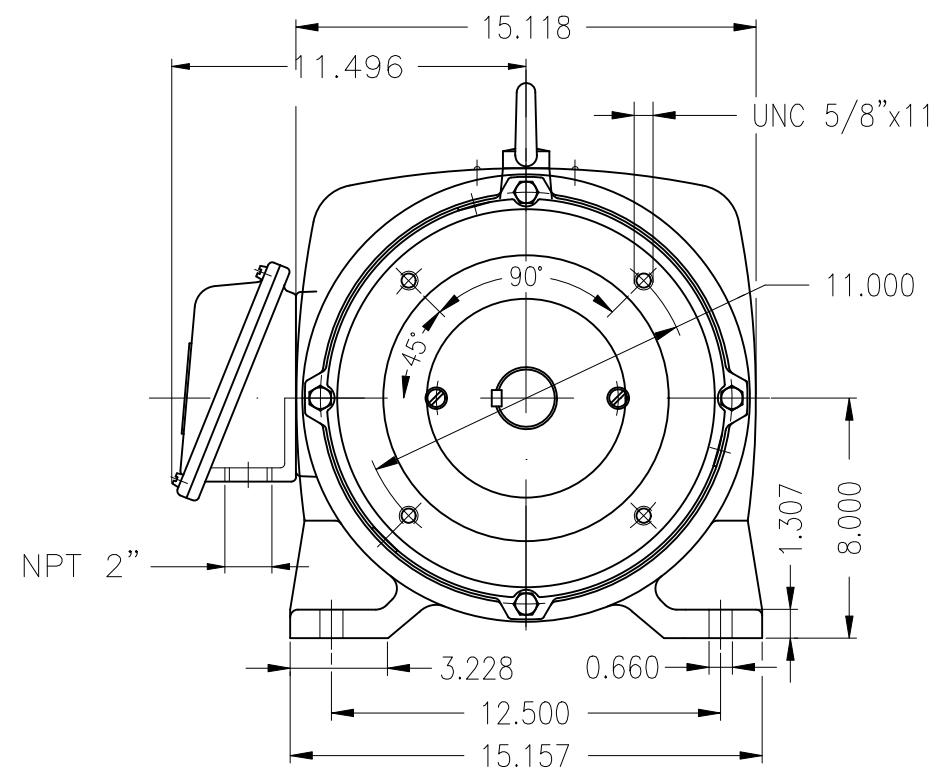


40 HP	04 Poles	60 Hz	A
-------	----------	-------	---

			HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS	EXECUTED	CHECKED	RELEASED	DATE	VER

EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP NEMA PREM. EFF.	PREVIEW		
CHECKED			FRAME 324JM IP23 ODP	WDD	00	
RELEASED						
REL. DATE		WMO	Jaraguá do Sul	Product Engineering	SHEET	1 / 1