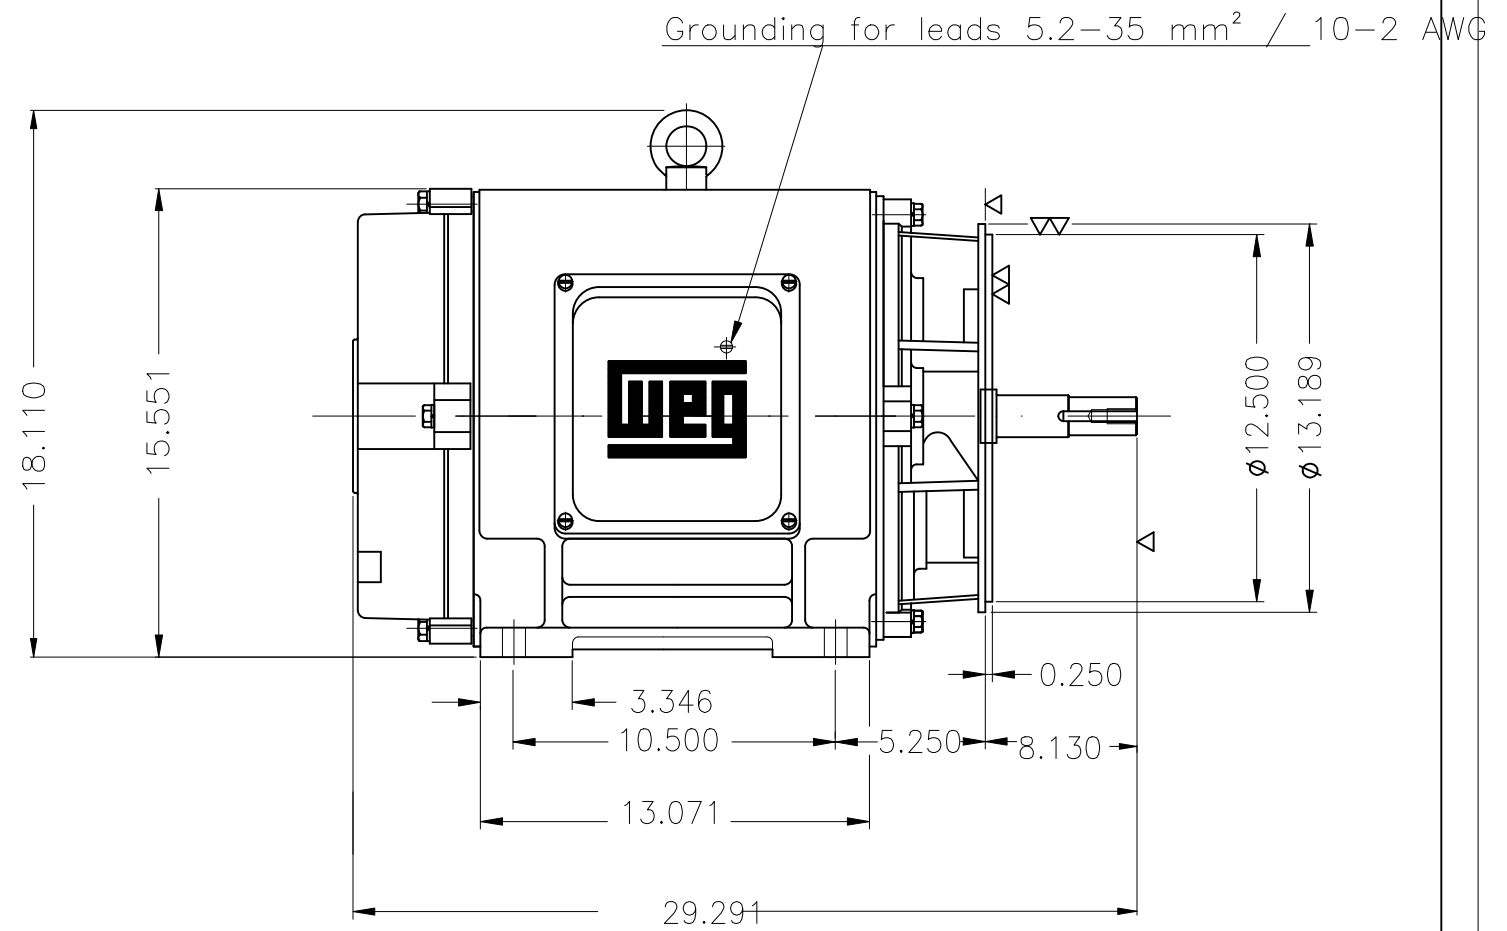
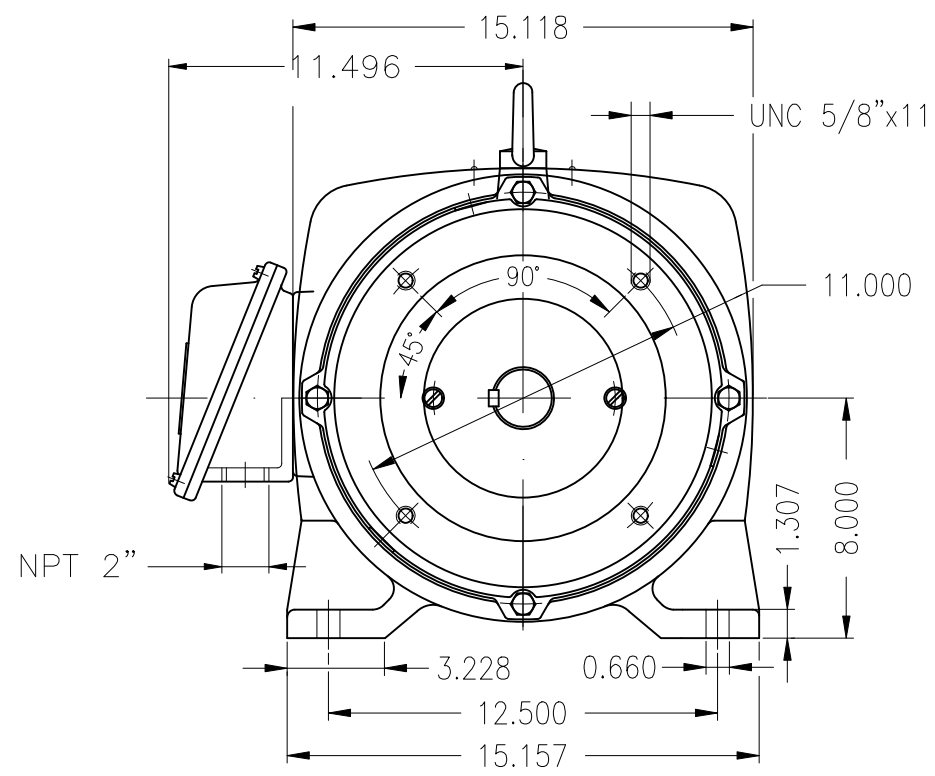


50 HP 02 Poles 60 Hz A

HYBRISUSER 00

ECM LOC SUMMARY OF MODIFICATIONS EXECUTED CHECKED RELEASED DATE VER

EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.	PREVIEW		
CHECKED			FRAME 324JP IP23 ODP	WDD	00	
RELEASED						
REL. DATE			WMO Jaragua do Sul	Product Engineering	SHEET 1 / 1	

Certification UL/FIRE PUMP
Color RAL 5009
Painting plan 203A
Mounting B34R(D)