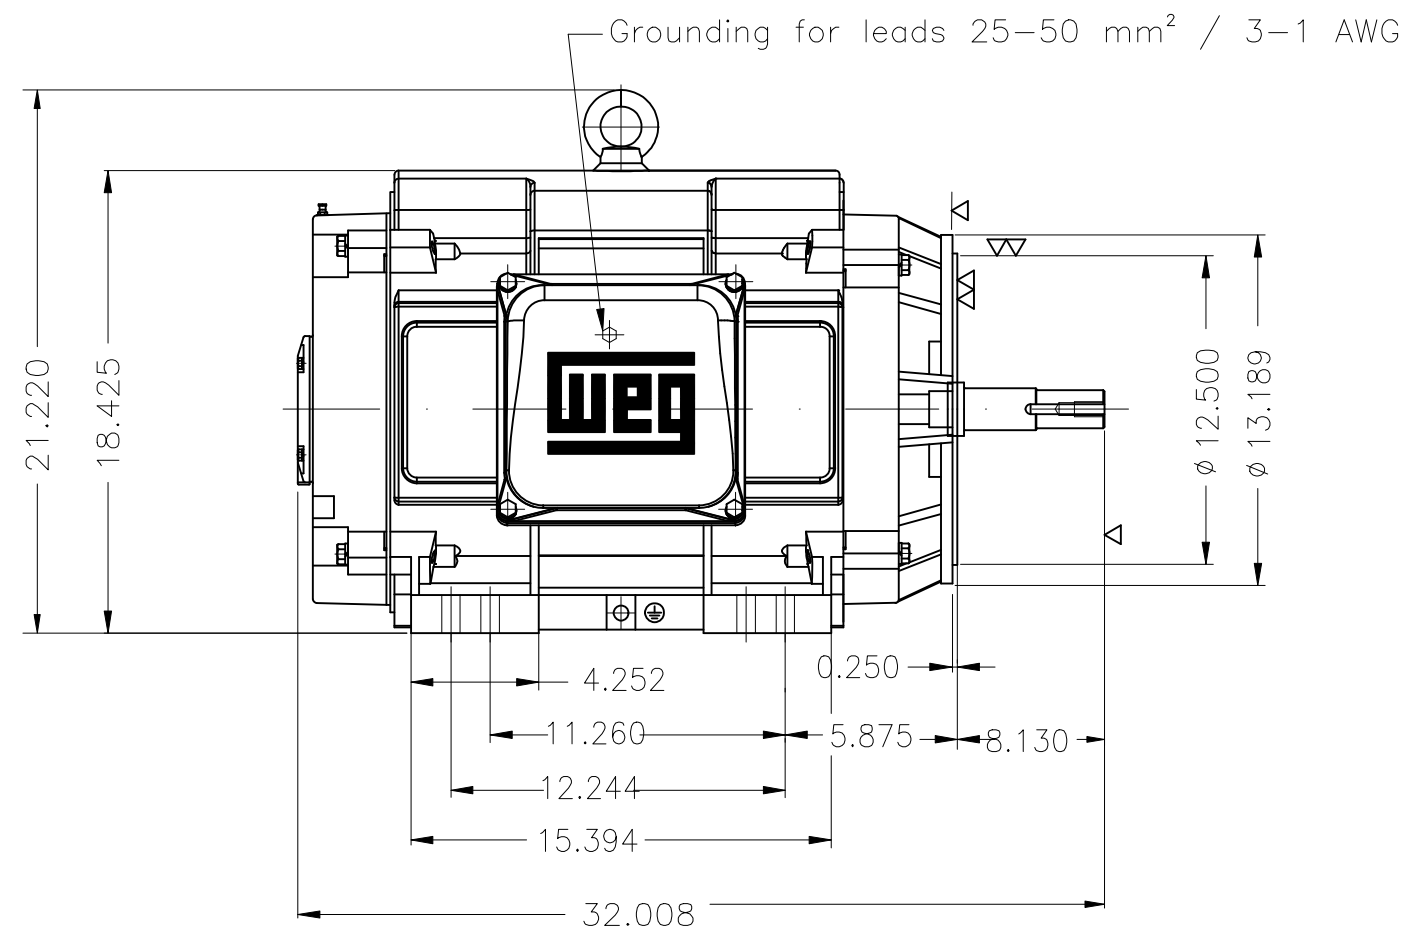
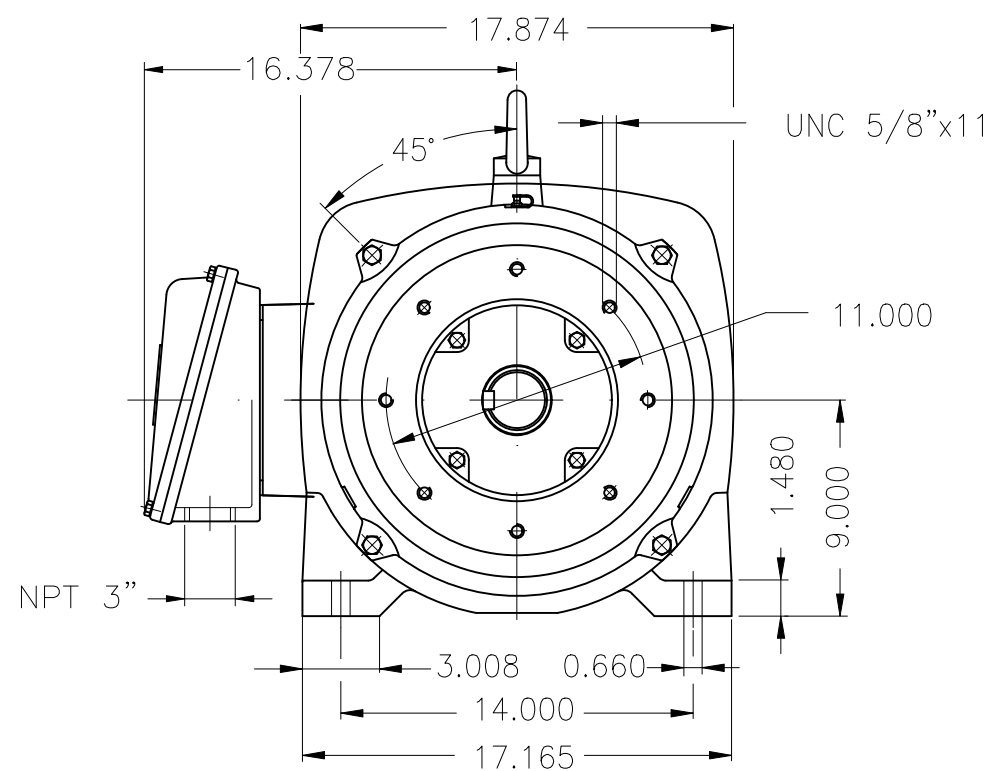



75 HP 02 Poles 60 Hz										A
						HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP NEMA PREM. EFF. FRAME 364/5JP IP23 ODP				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1	/	1		