


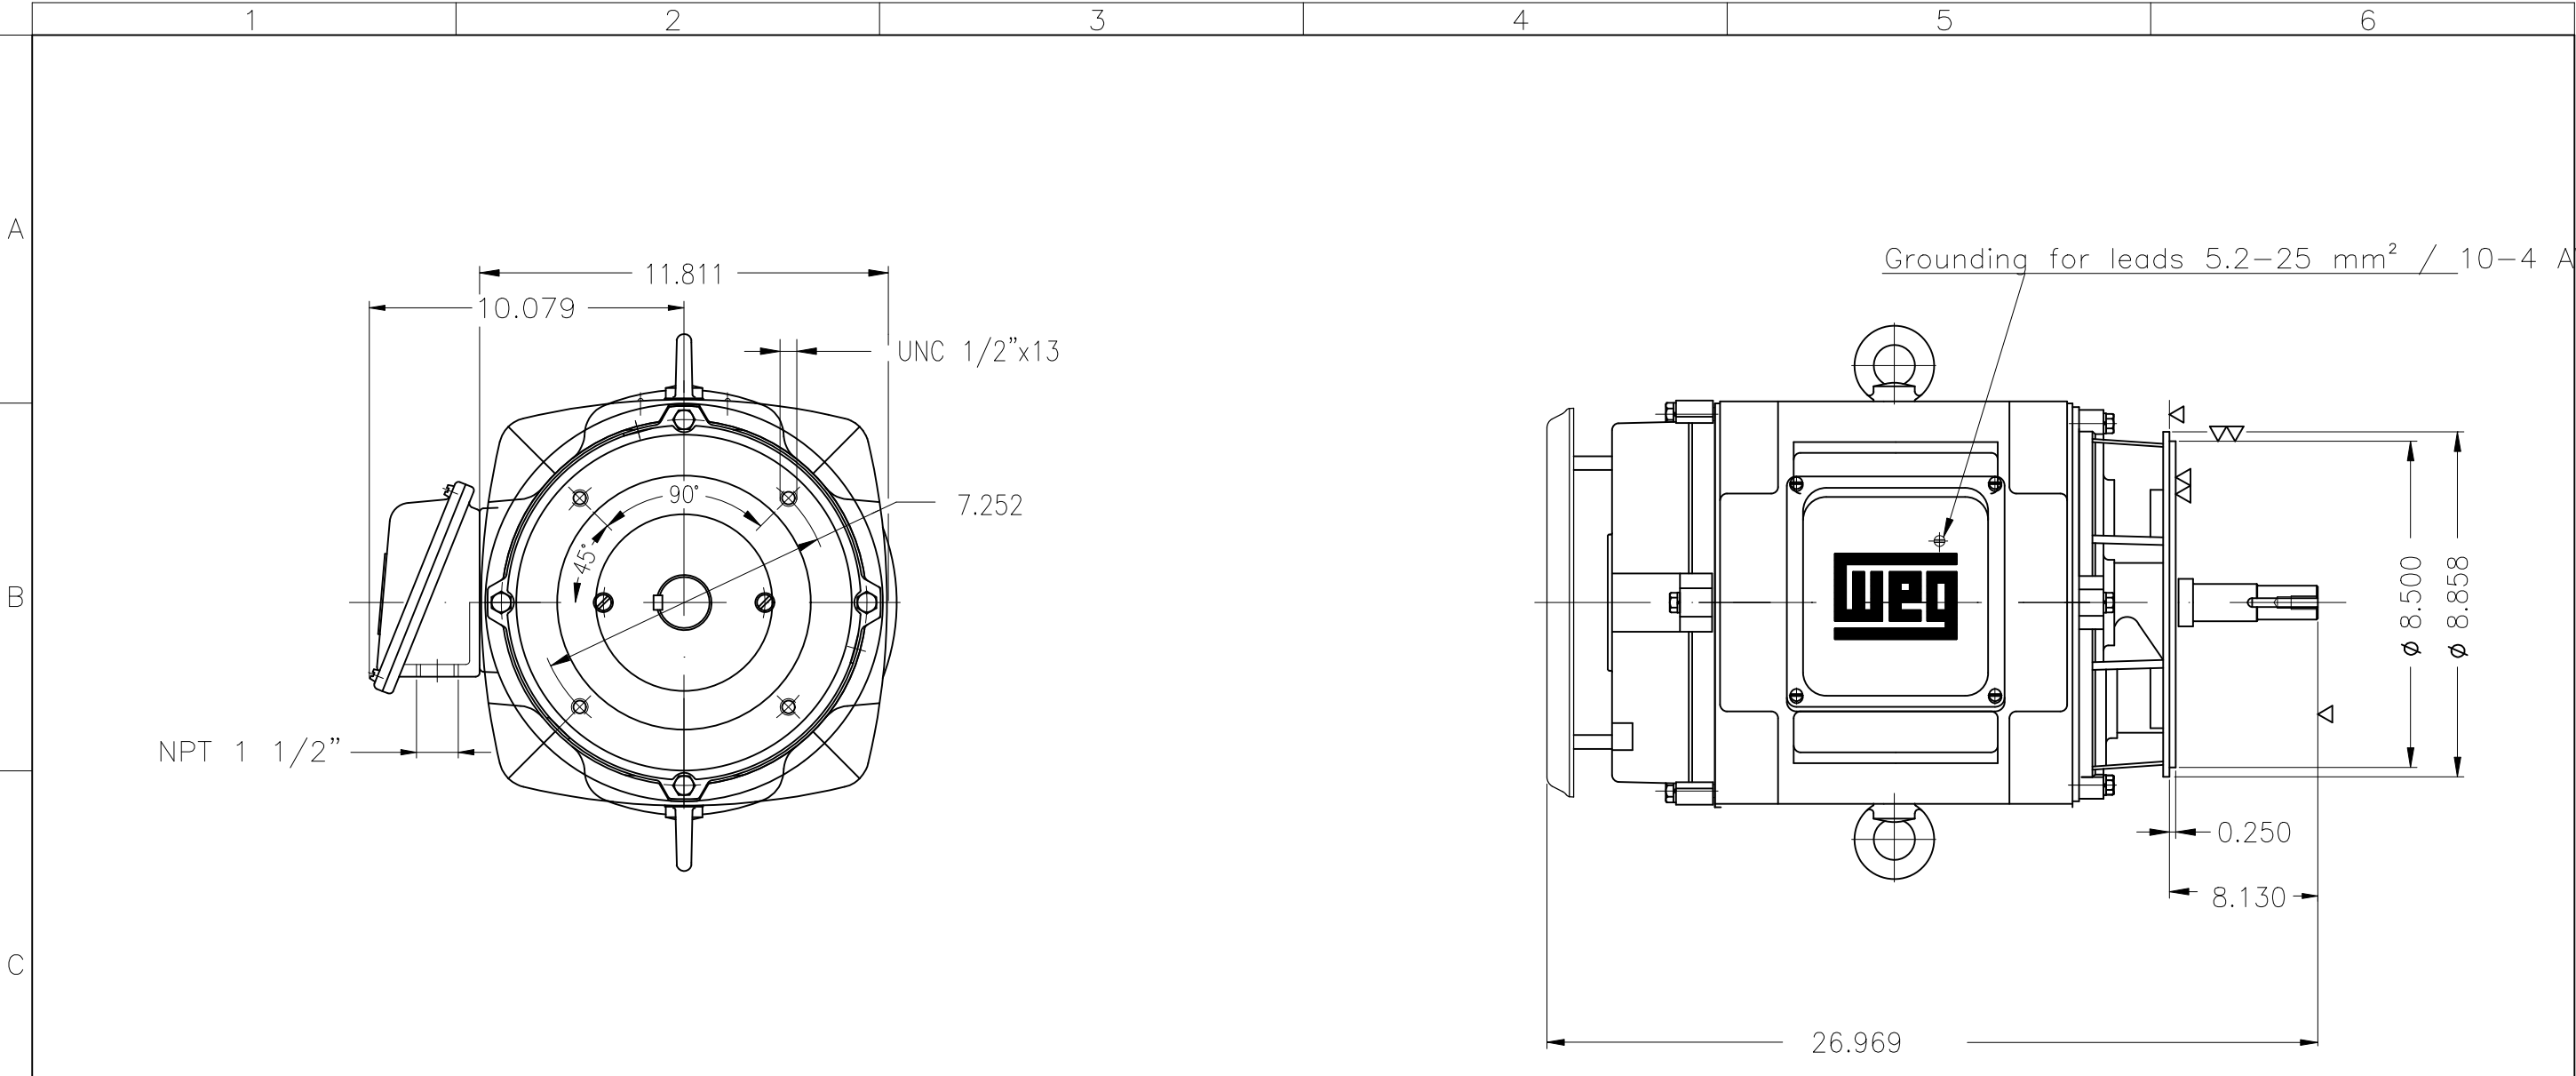

D														
			7.5 HP 06 Poles 60 Hz										A	
E								HYBRISUSER						00
	ECM	LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE	VER		
	EXECUTED	HYBRISUSER			THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.				PREVIEW		WDD 00			
	CHECKED				FRAME 254JP IP23 ODP									
	RELEASED													
	REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1	/	1					
Certification UL/FIRE PUMP														
Color RAL 5009														
Painting plan 203A														
Mounting V18														