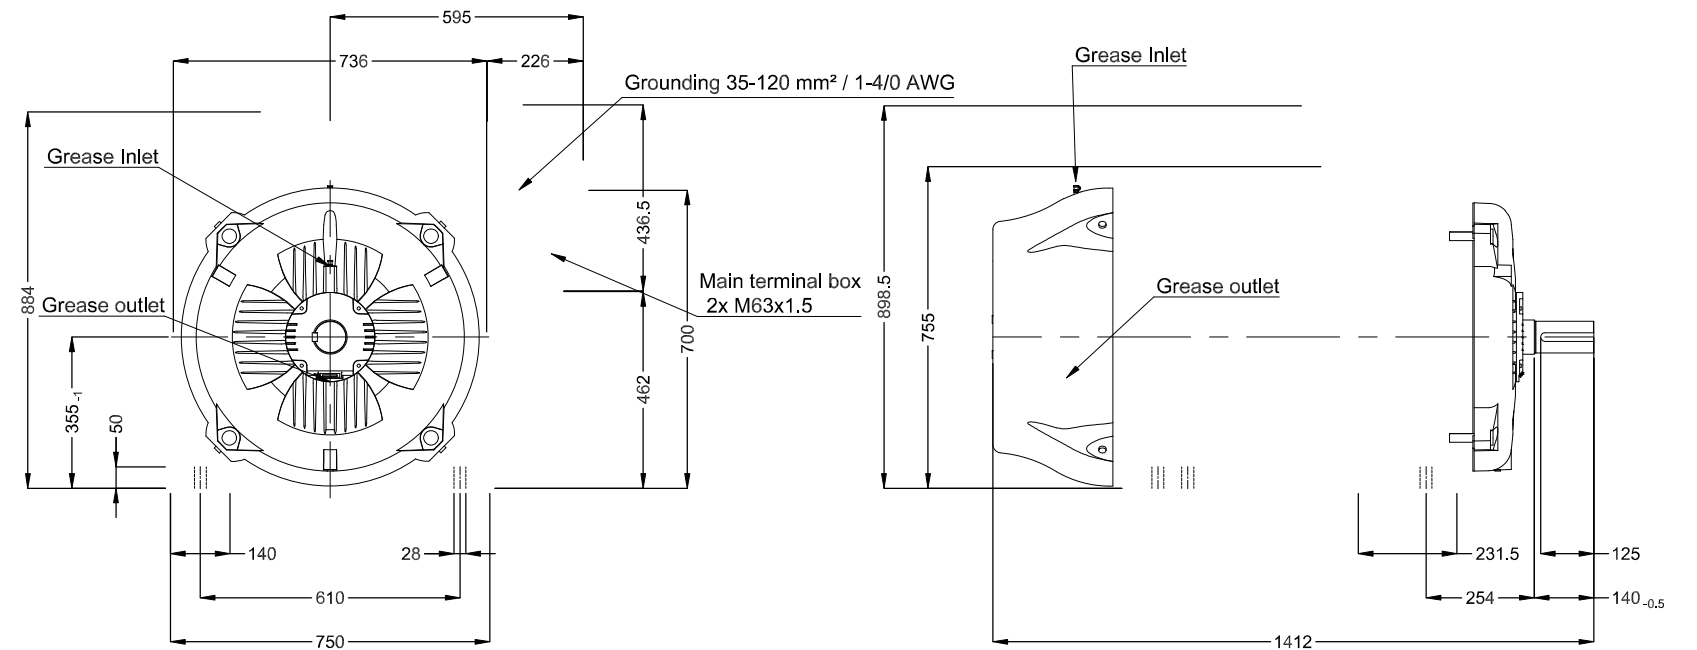
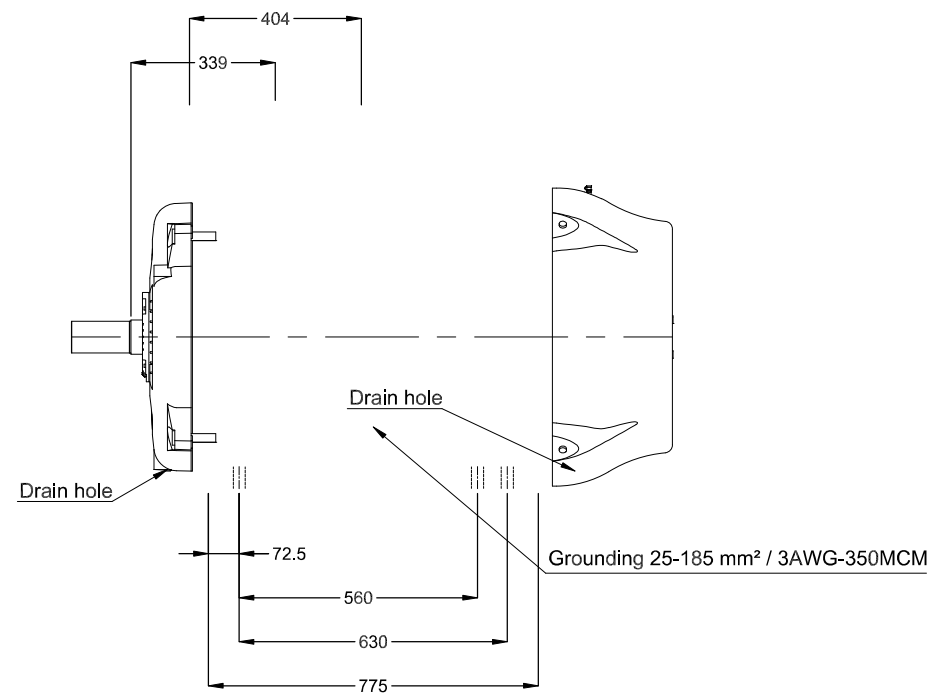


400 HP 02 Poles 60 Hz										A
				HYBRISUSER					00	
ECM		LOC		SUMMARY OF MODIFICATIONS			EXECUTED		CHECKED	
							RELEASED		DATE	
EXECUTED		HYBRISUSER		 THREE PH. MOTOR W22 IE3 FRAME 355M/L IP55 TEFC			PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE										
							SHEET		/	