
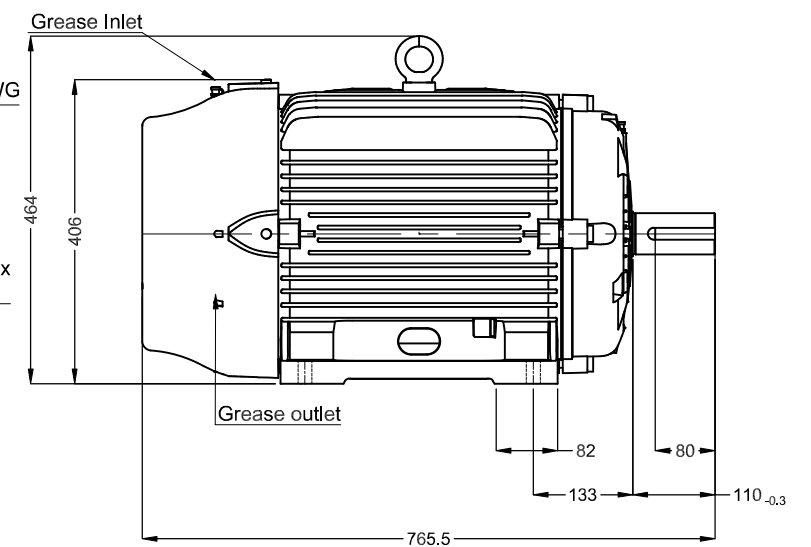
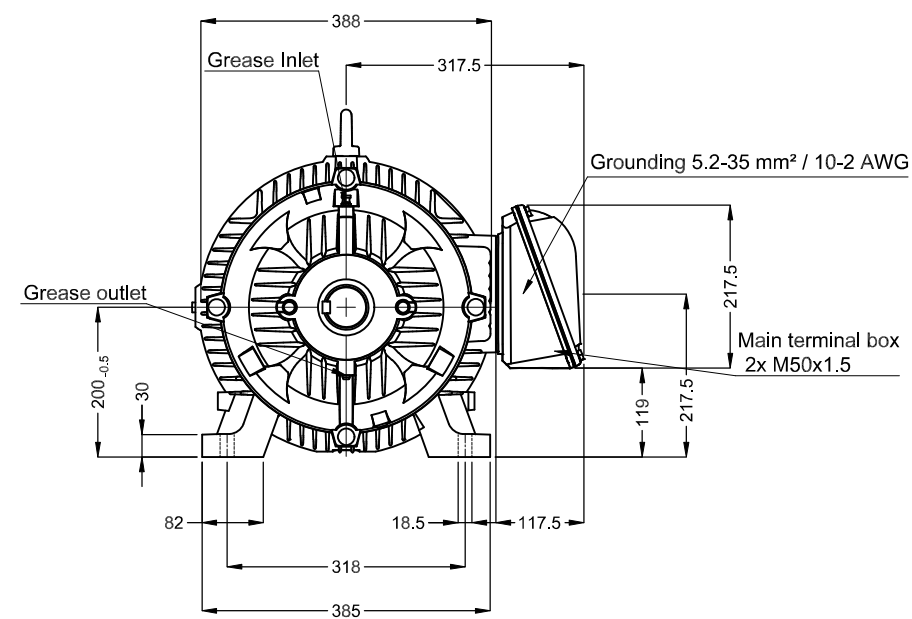


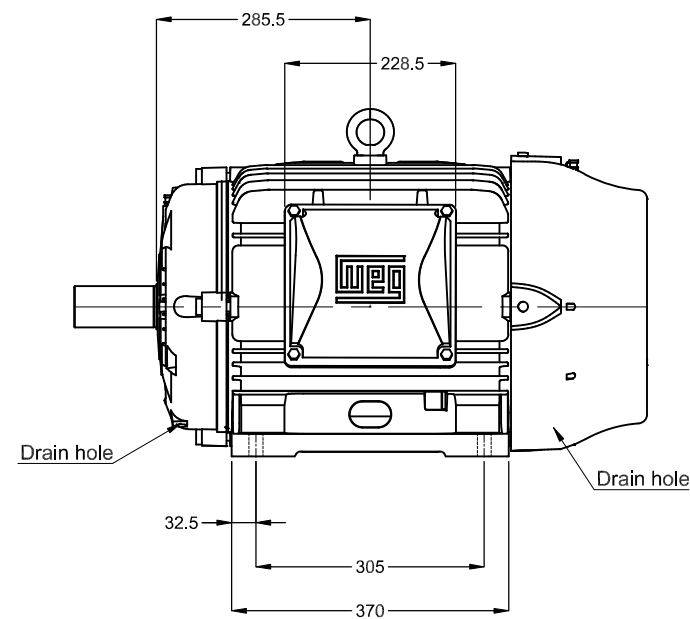

20 HP 08 Poles 60 Hz										A
								HYBRISUSER		
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR W22 IE2 FRAME 200L IP55 TEFC				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE										