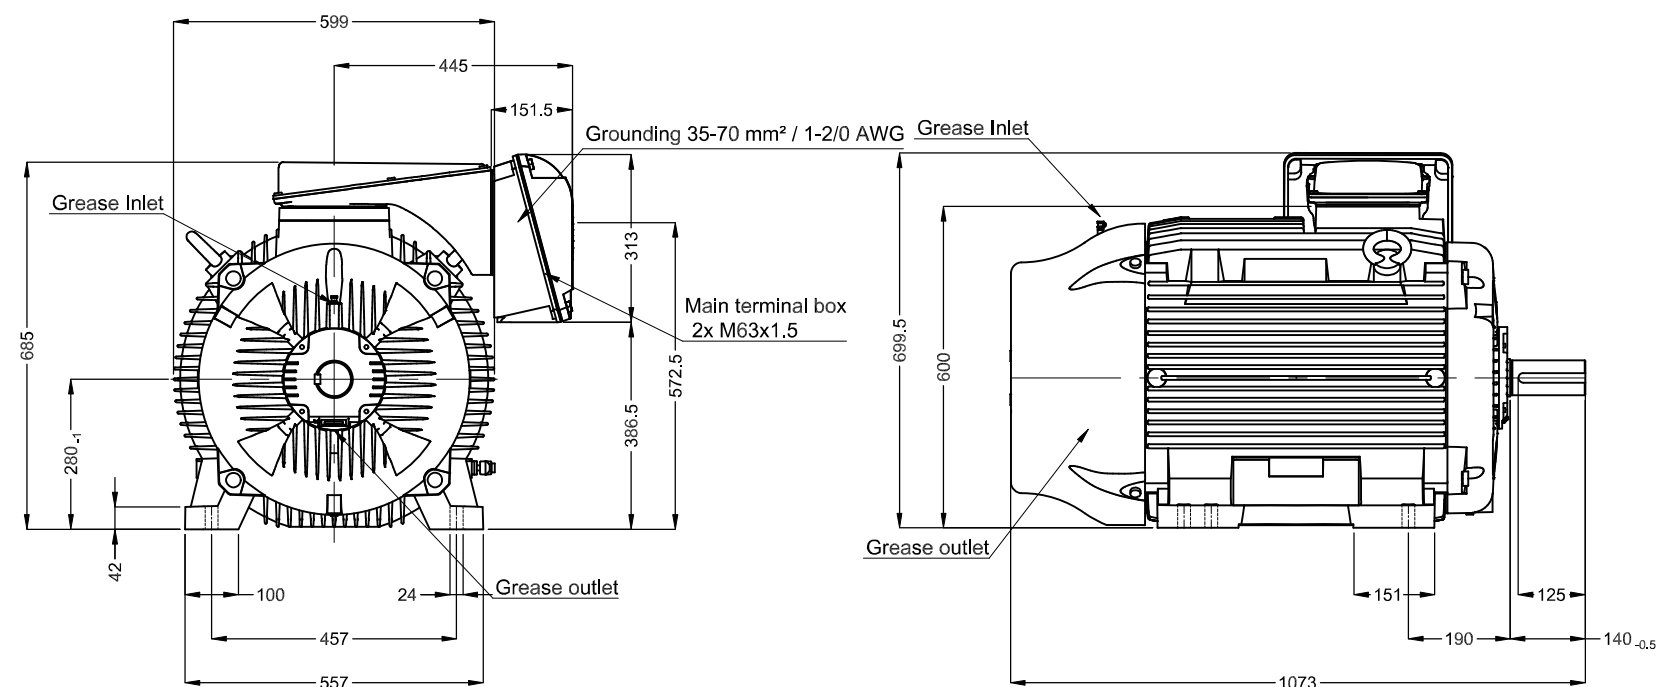
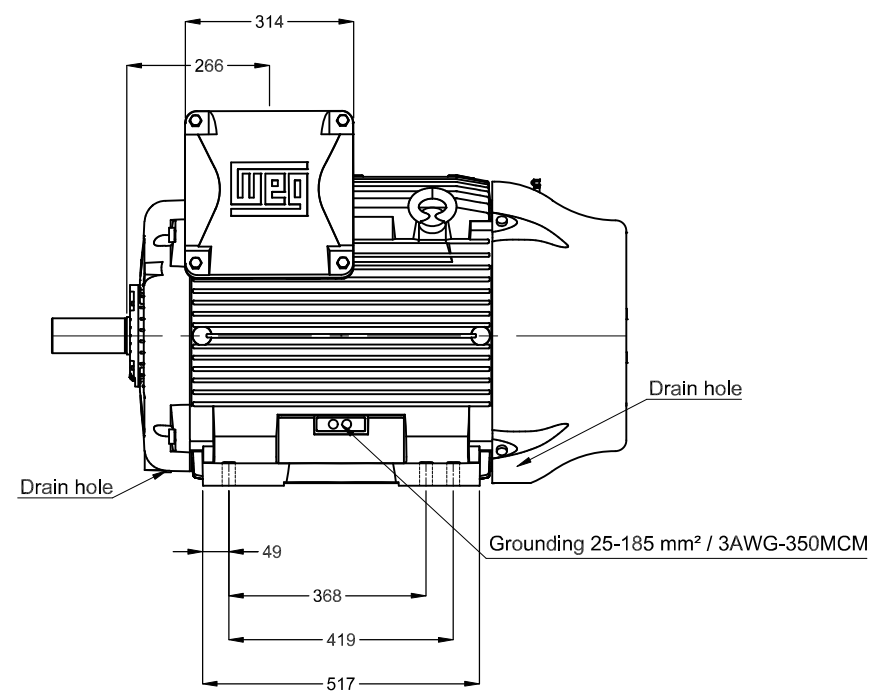



100 HP 02 Poles 60 Hz										A
						HYBRISUSER				00
ECM		LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR W22 IE3 FRAME 280S/M IP55 TEFC				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE										
						SHEET				