


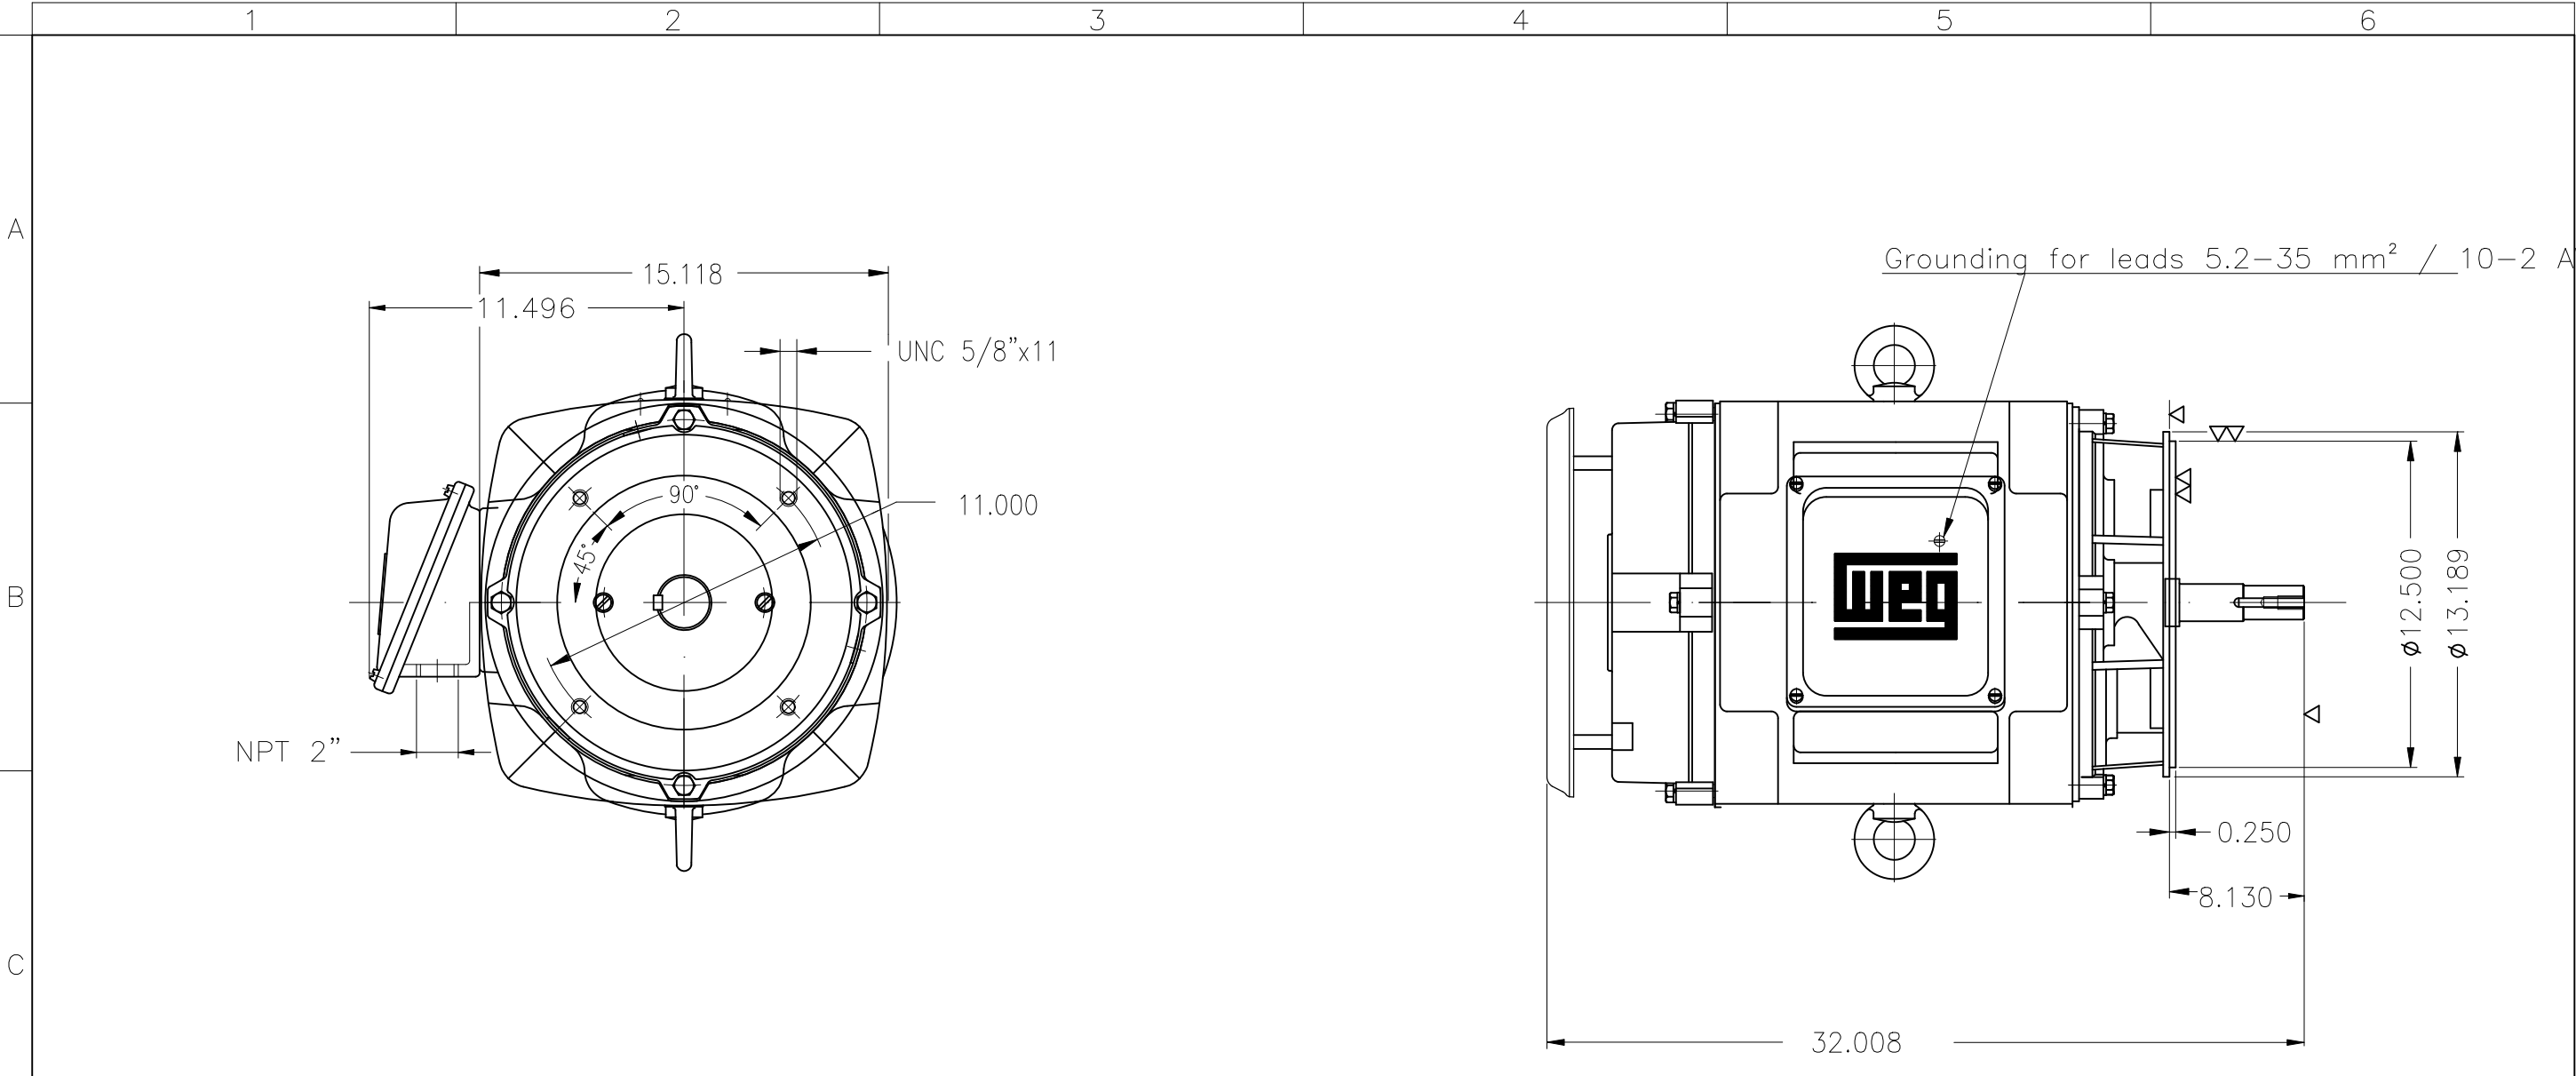

D															
		50 HP 02 Poles 60 Hz													
E															
Certification UL/FIRE PUMP						HYBRISUSER								00	
Color RAL 3002															
Painting plan 203A															
Mounting NEMA W-6															
Mounting V18															

ECM		LOC		SUMMARY OF MODIFICATIONS		EXECUTED		CHECKED		RELEASED		DATE		VER	
EXECUTED		HYBRISUSER				THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF. FRAME 324JP IP23 ODP		PREVIEW WDD 00				SHEET 1 / 1			
CHECKED															
RELEASED															
REL. DATE				WMO Jaragua do Sul		Product Engineering									