


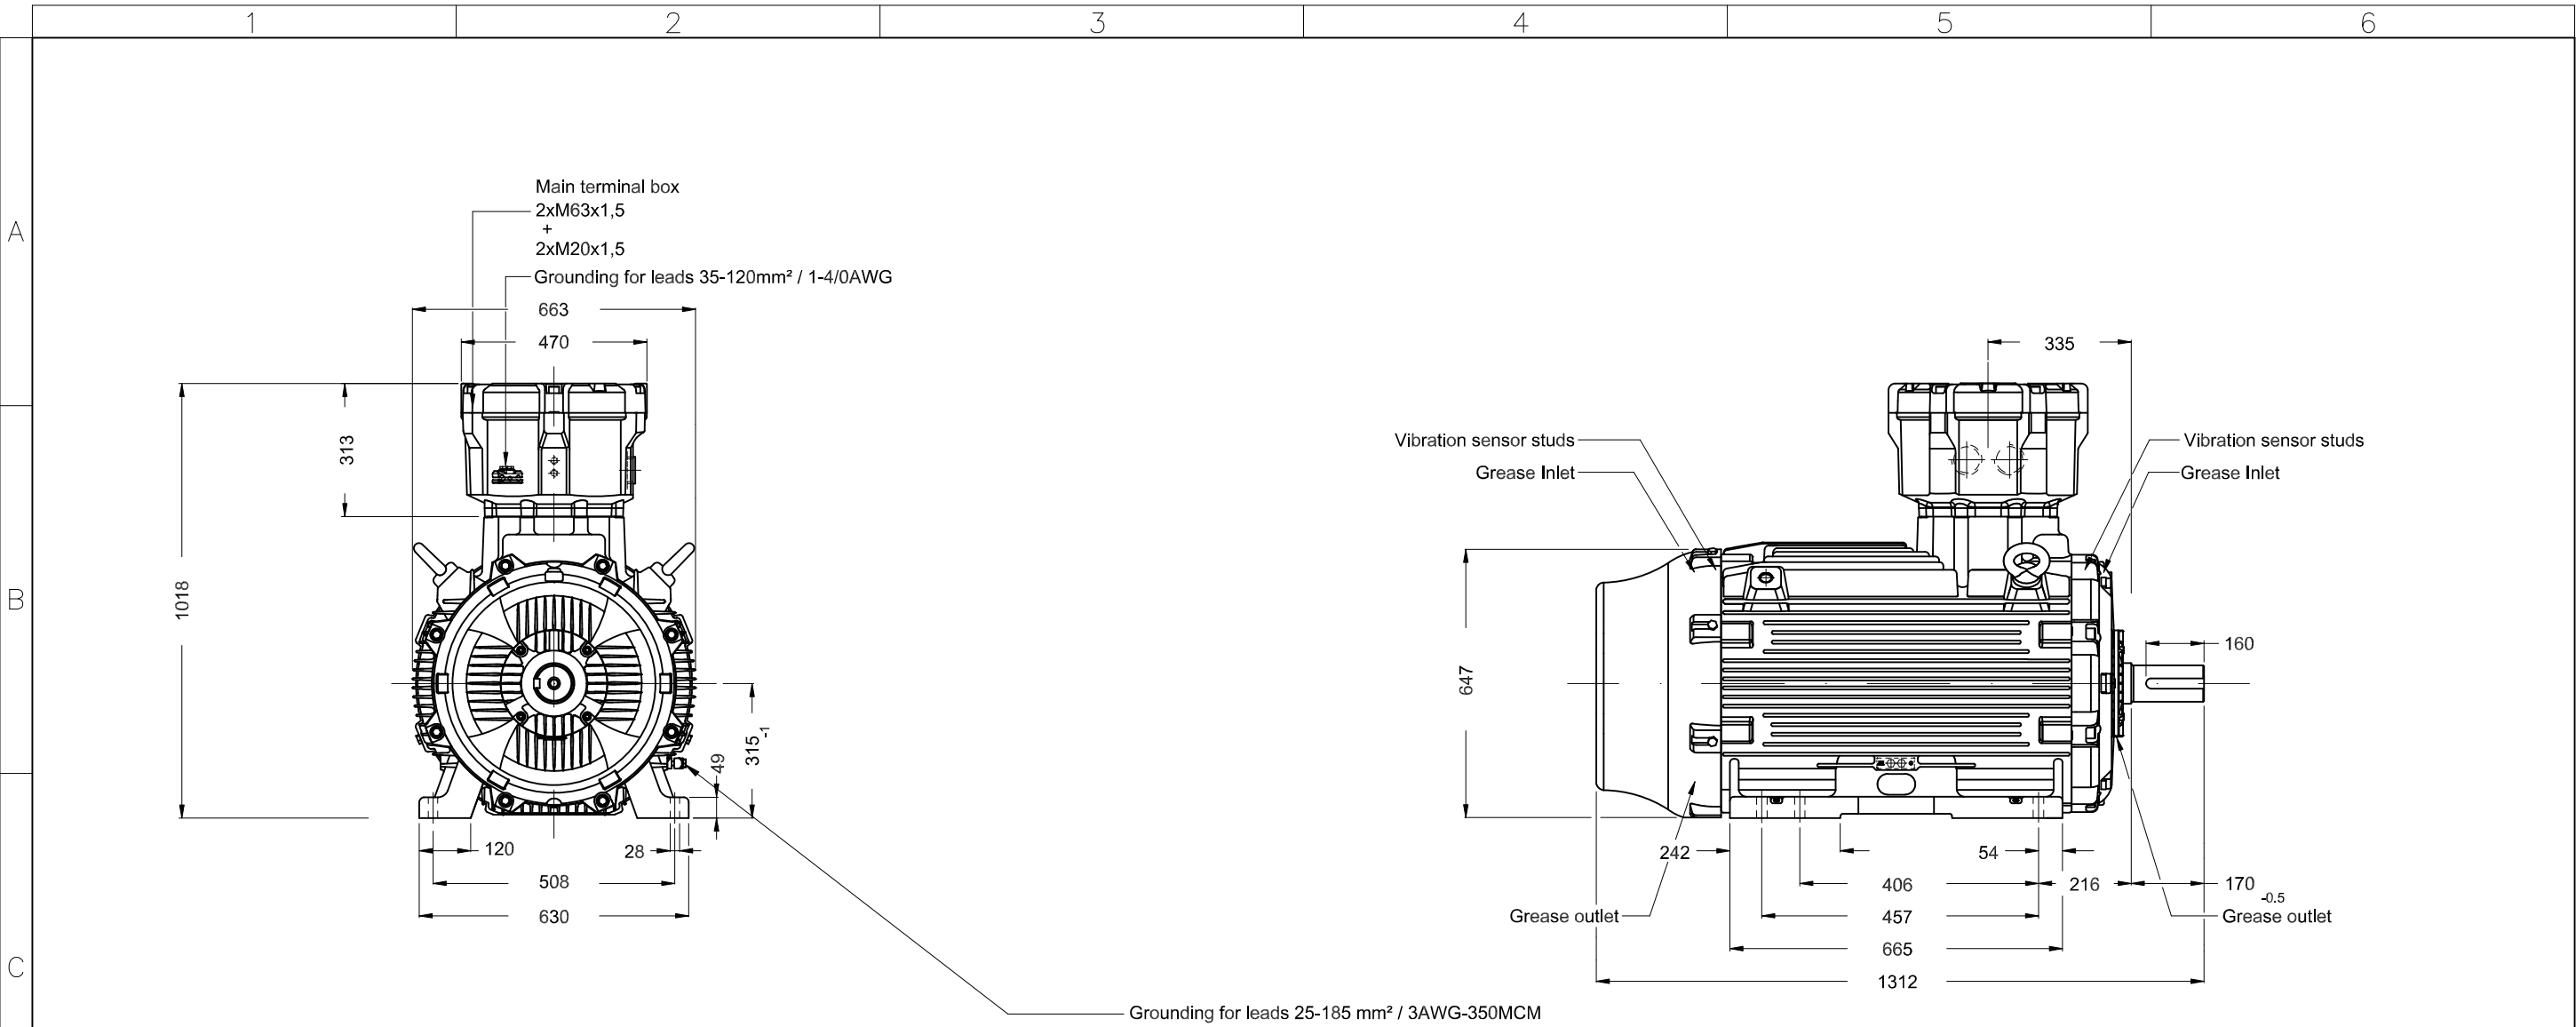

E	75 kW 06 Poles 50 Hz										A
SPM studs		Color RAL 5009		Painting plan 205P		Mounting B3T					
		DM20 WEG WPR-7339 (DS DIN332)		Vibration sensor studs detail				HYBRISUSER		00	
ECM		LOC		SUMMARY OF MODIFICATIONS		EXECUTED		CHECKED		RELEASED	
EXECUTED		HYBRISUSER				THREE PH. MOTOR W22Xdb IE2		PREVIEW			
CHECKED						FRAME 315S/M IP56 TEFC		WDD		00	
RELEASED								SHEET		1 / 1	
REL. DATE				WMO		Jaragua do Sul		Product Engineering			