


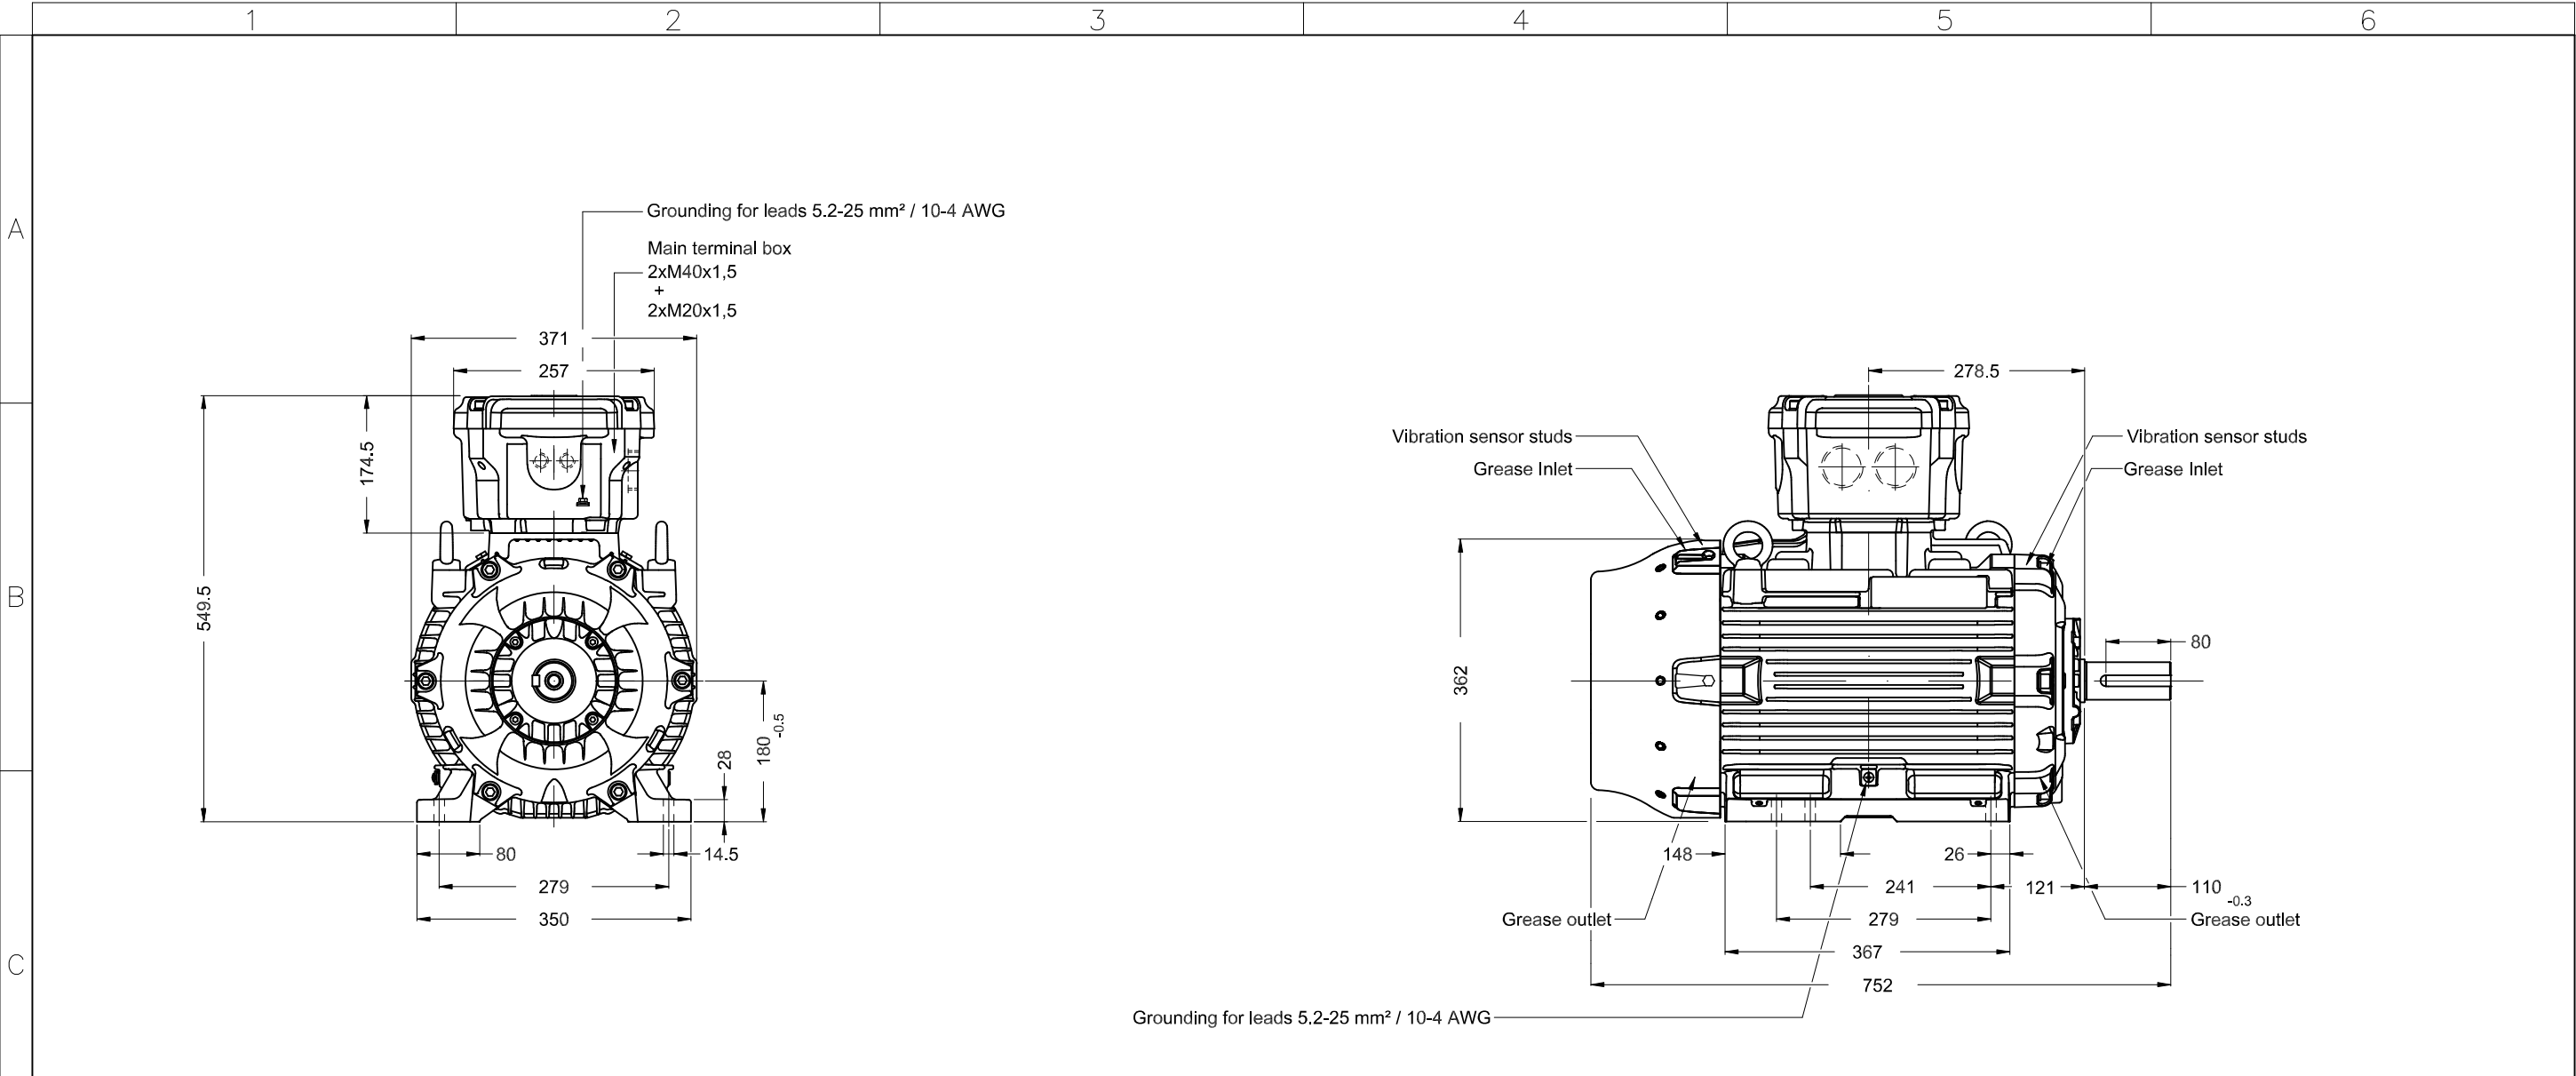

E										
	22 kW 02 Poles 50 Hz									
D							HYBRISUSER			
	ECM		LOC		SUMMARY OF MODIFICATIONS		EXECUTED		CHECKED	
	EXECUTED		HYBRISUSER		THREE PH. MOTOR W22Xdb IE3					
	CHECKED				FRAME 180M/L IP56 TEFC					
	RELEASED									
C	REL. DATE				WMO		Jaragua do Sul		Product Engineering	
									SHEET	
									1 / 1	
B										
A										


SPM studs

Color RAL 5009

Painting plan 205P


Mounting B3T

DE Shaft End



DM16 WEG WPR-7339 (DS DIN332)

Vibration sensor studs detail



22 kW 02 Poles 50 Hz

Dimensions in mm

A3 XME