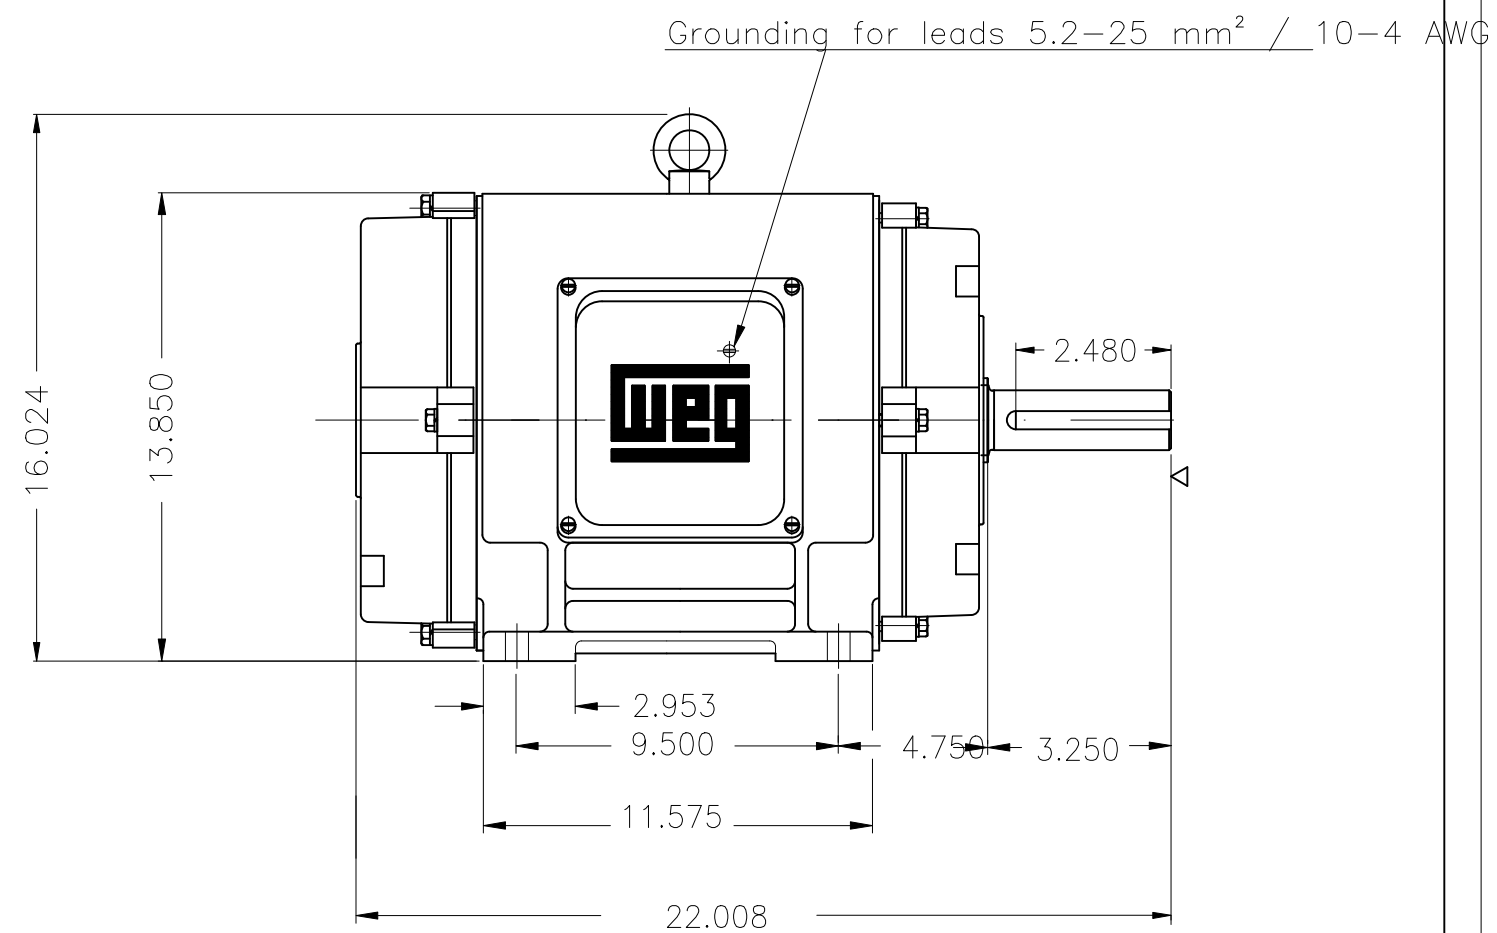
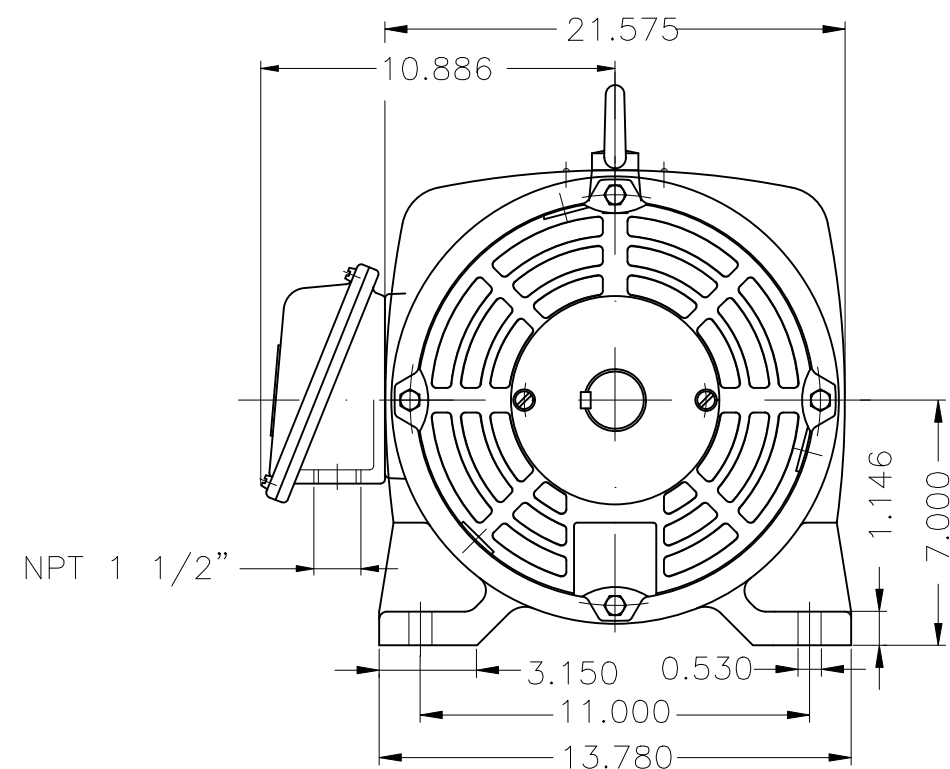


Certification UL/FIRE PUMP
Color RAL 3002
Painting plan 203A
Mounting B3R(D)

30 HP 02 Poles 60 Hz										A	
							HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	 THREE PH. MOTOR GENERAL HIGH EFF. FRAME 284TS IP23 ODP					PREVIEW WDD 00				
CHECKED											
RELEASED											
REL. DATE		WMO	Jaragua do Sul			Product Engineering	SHEET	1 / 1			