
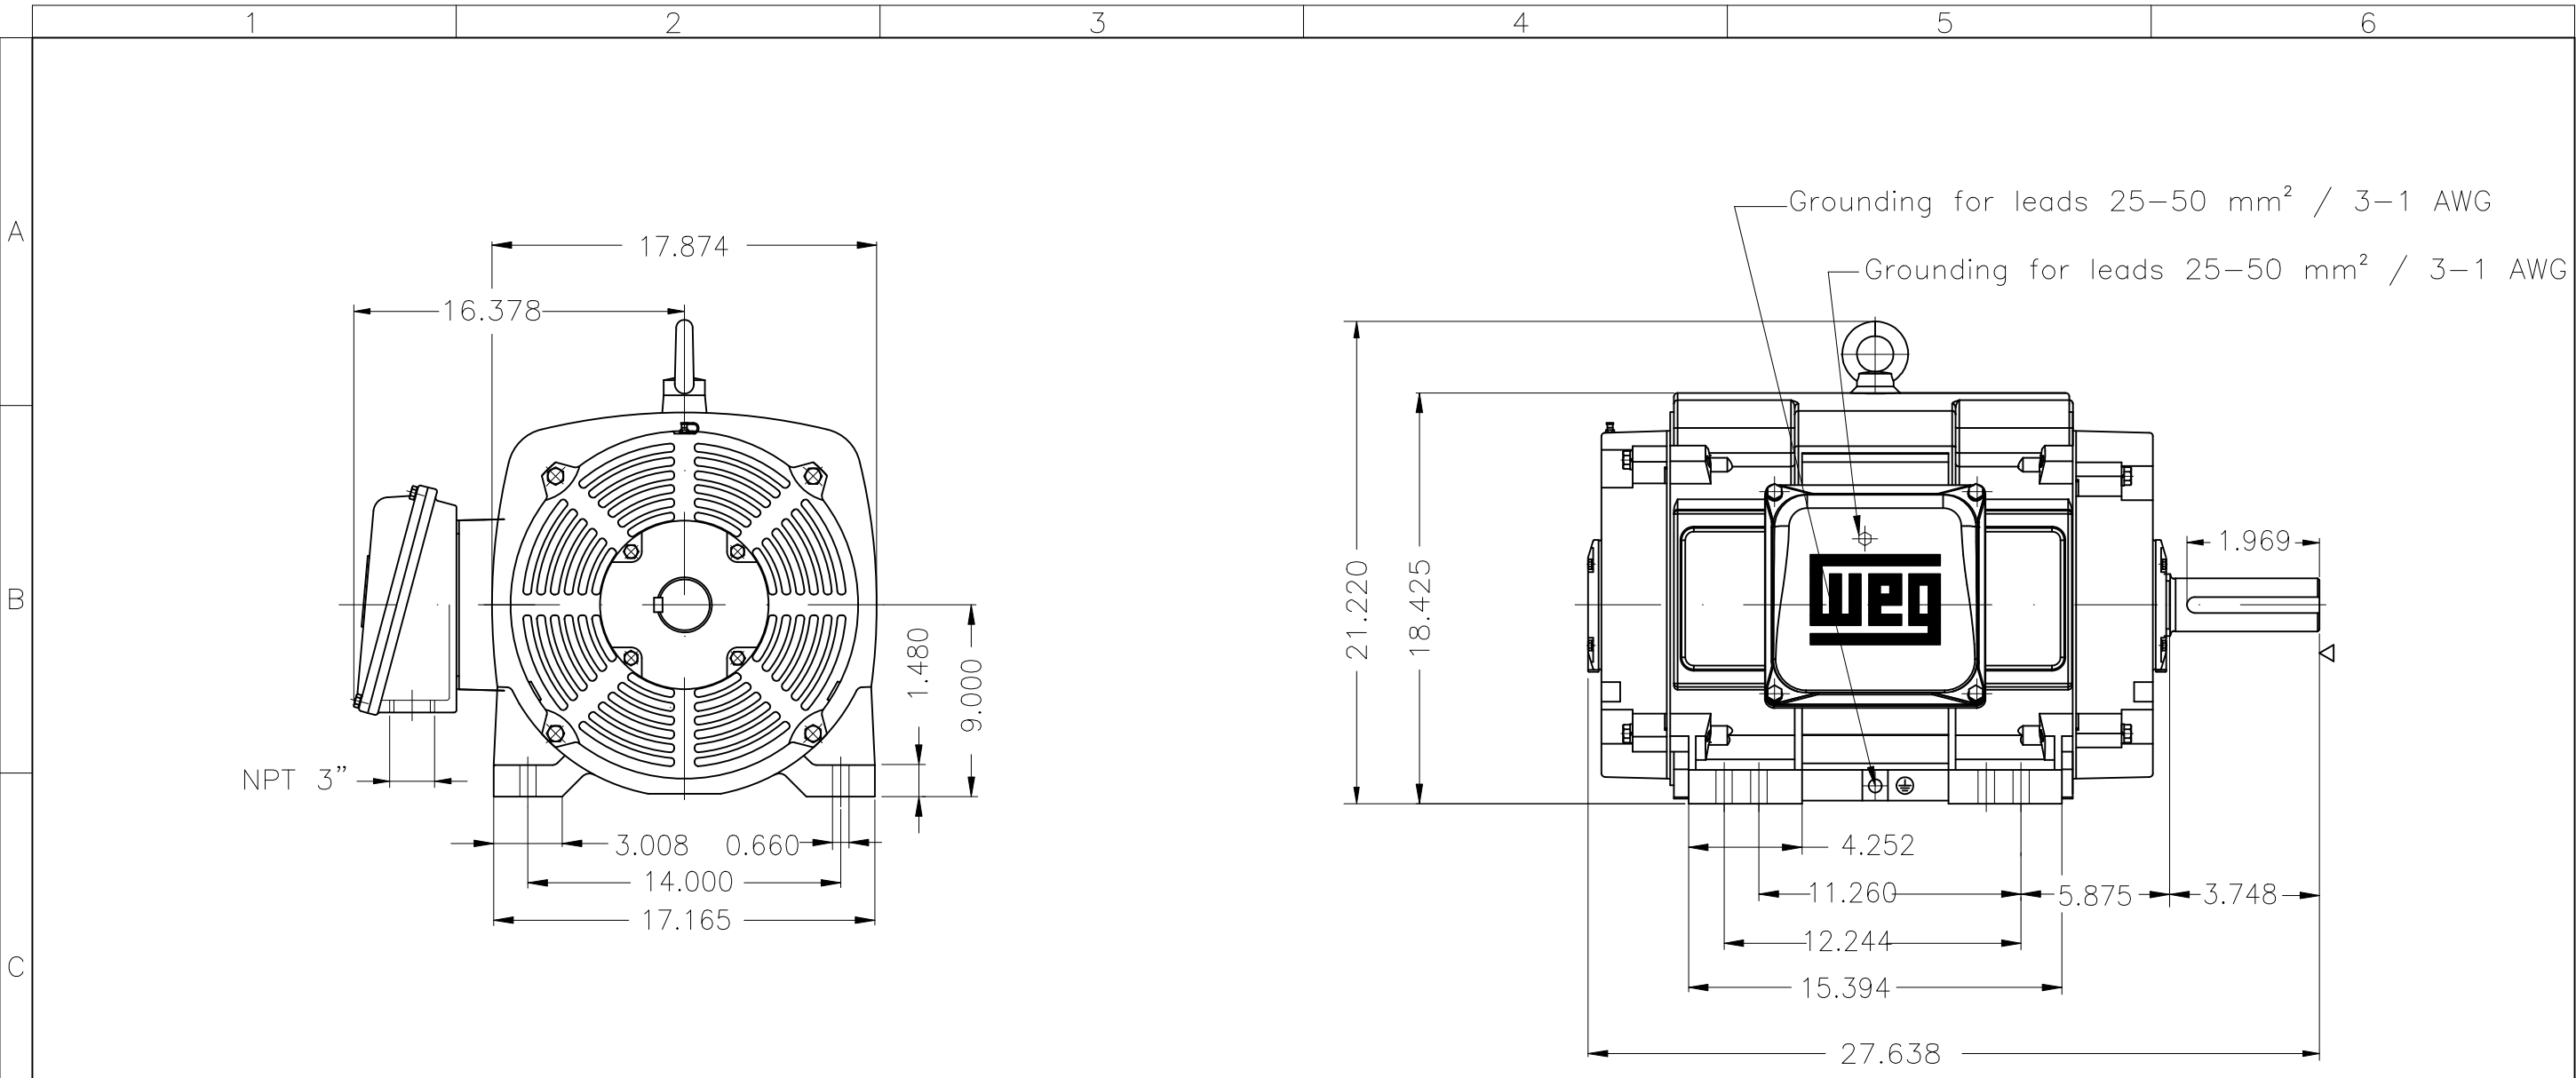


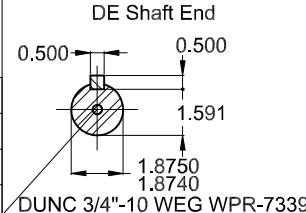

D					100 HP 02 Poles 60 Hz										A		
												HYBRISUSER					00
					ECM	LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE	VER	
					EXECUTED	HYBRISUSER		THREE PH. MOTOR GENERAL HIGH EFF. FRAME 364/5TS IP23 ODP					PREVIEW WDD 00				
					CHECKED												
					RELEASED												
					REL. DATE		WMO	Jaragua do Sul					Product Engineering	SHEET	1 / 1		

E														
Certification UL/FIRE PUMP														
Color RAL 3002														
Painting plan 203A														
Mounting B3R(D)														