


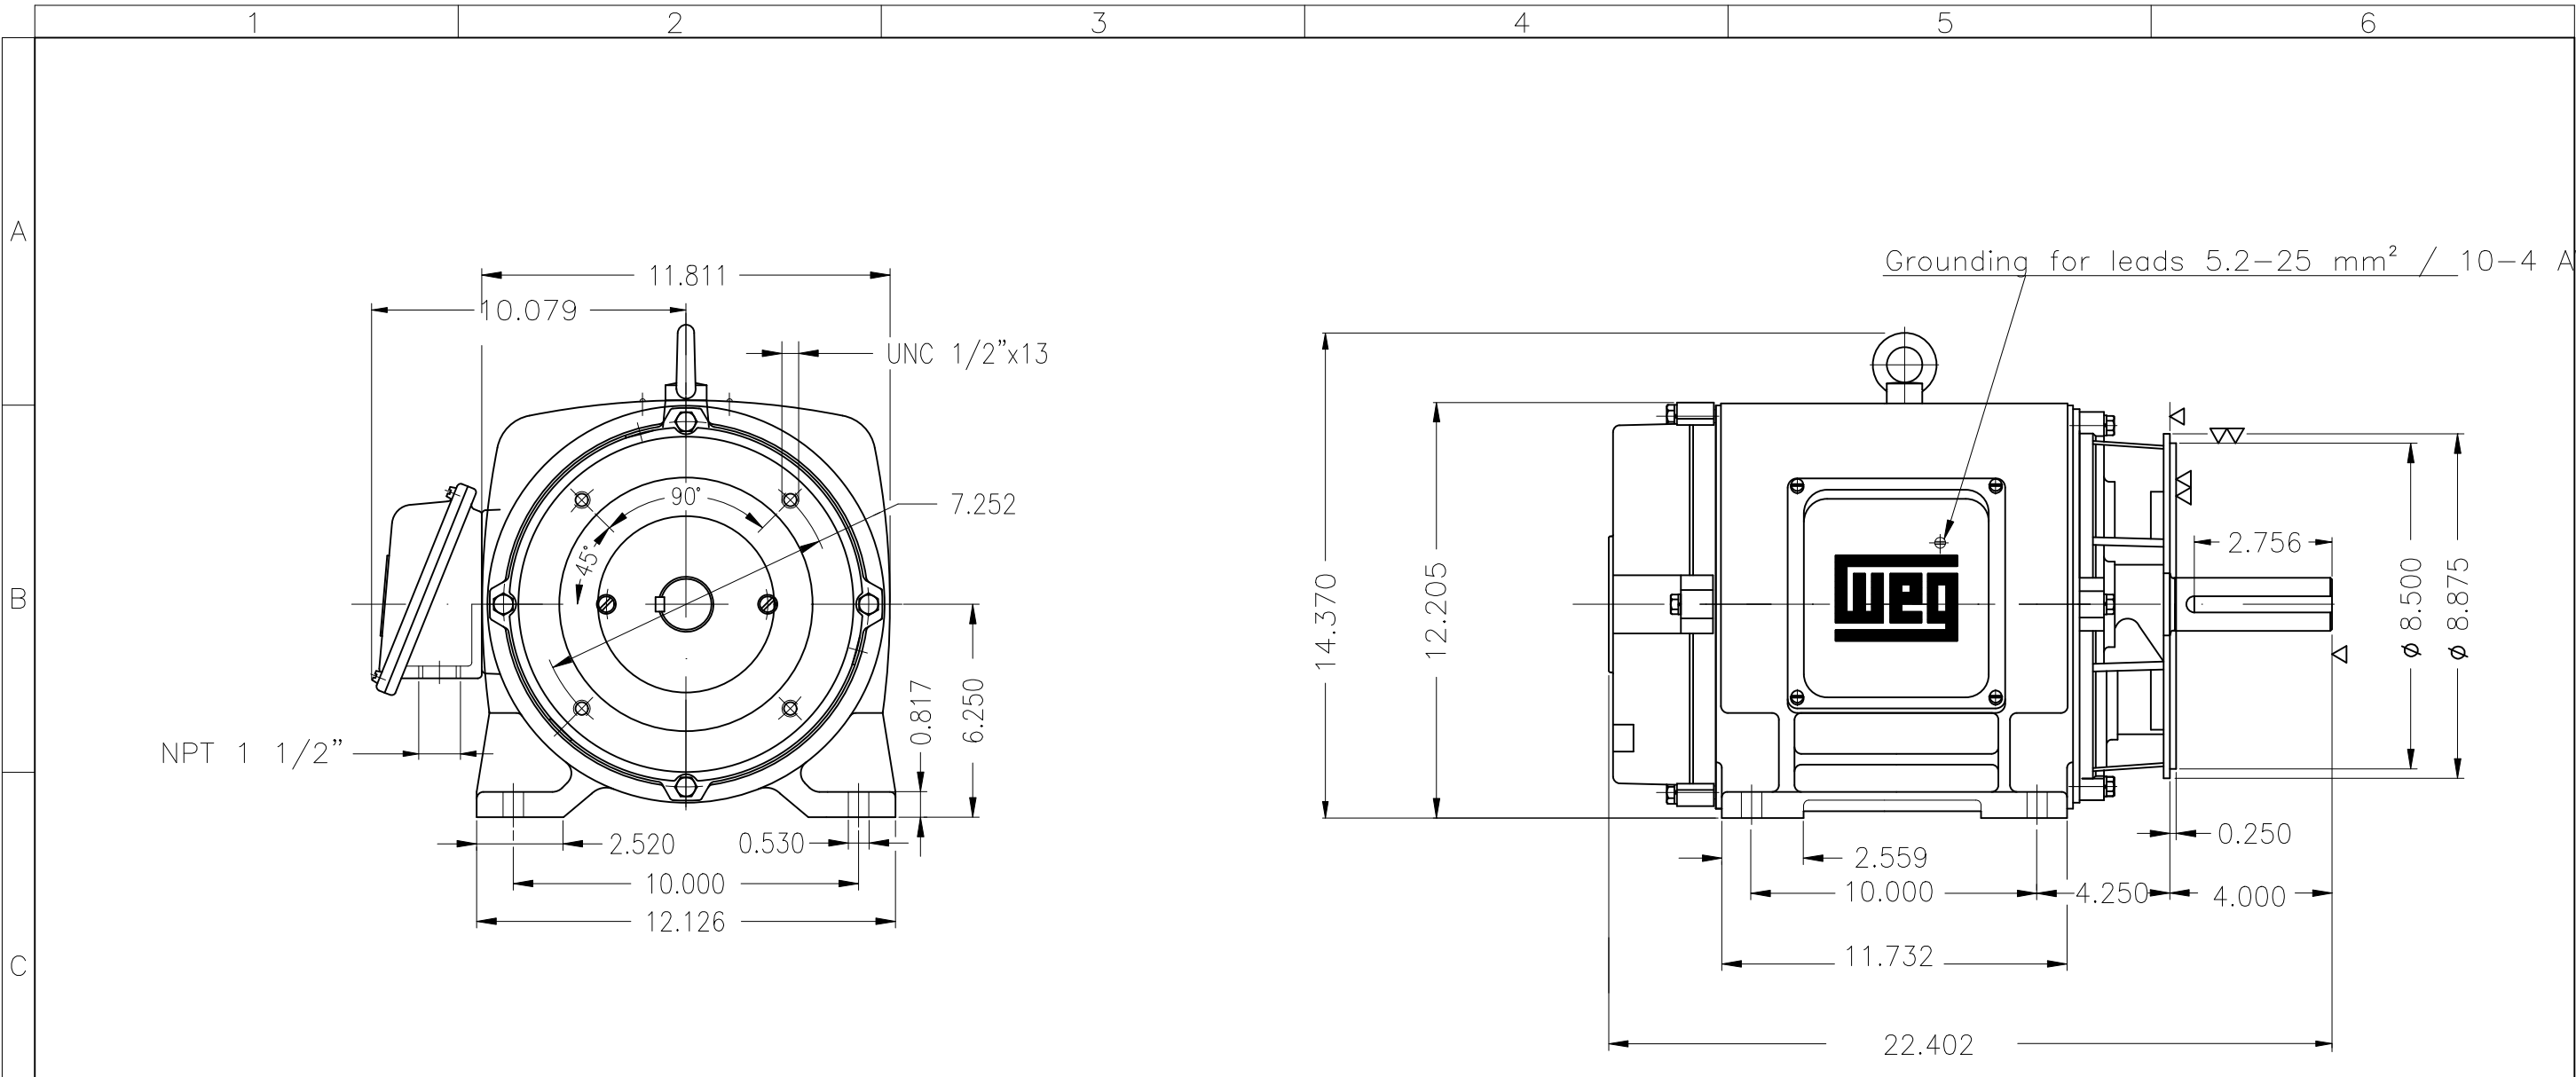

A		B		C		D		E		25 HP 02 Poles 60 Hz		A	
Certification UL/FIRE PUMP		Bearing cap		Color RAL 3002		Painting plan 203A		Mounting B34R(D)		DE Shaft End		0.375 0.375 1.416 1.6250 1.6240	
ECM		LOC		SUMMARY OF MODIFICATIONS		EXECUTED		CHECKED		RELEASED		DATE	
REL. DATE		WMO		Jaragua do Sul		Product Engineering		SHEET		1 / 1		PREVIEW	
WEG		WMO		Jaragua do Sul		Product Engineering		SHEET		1 / 1		PREVIEW	