
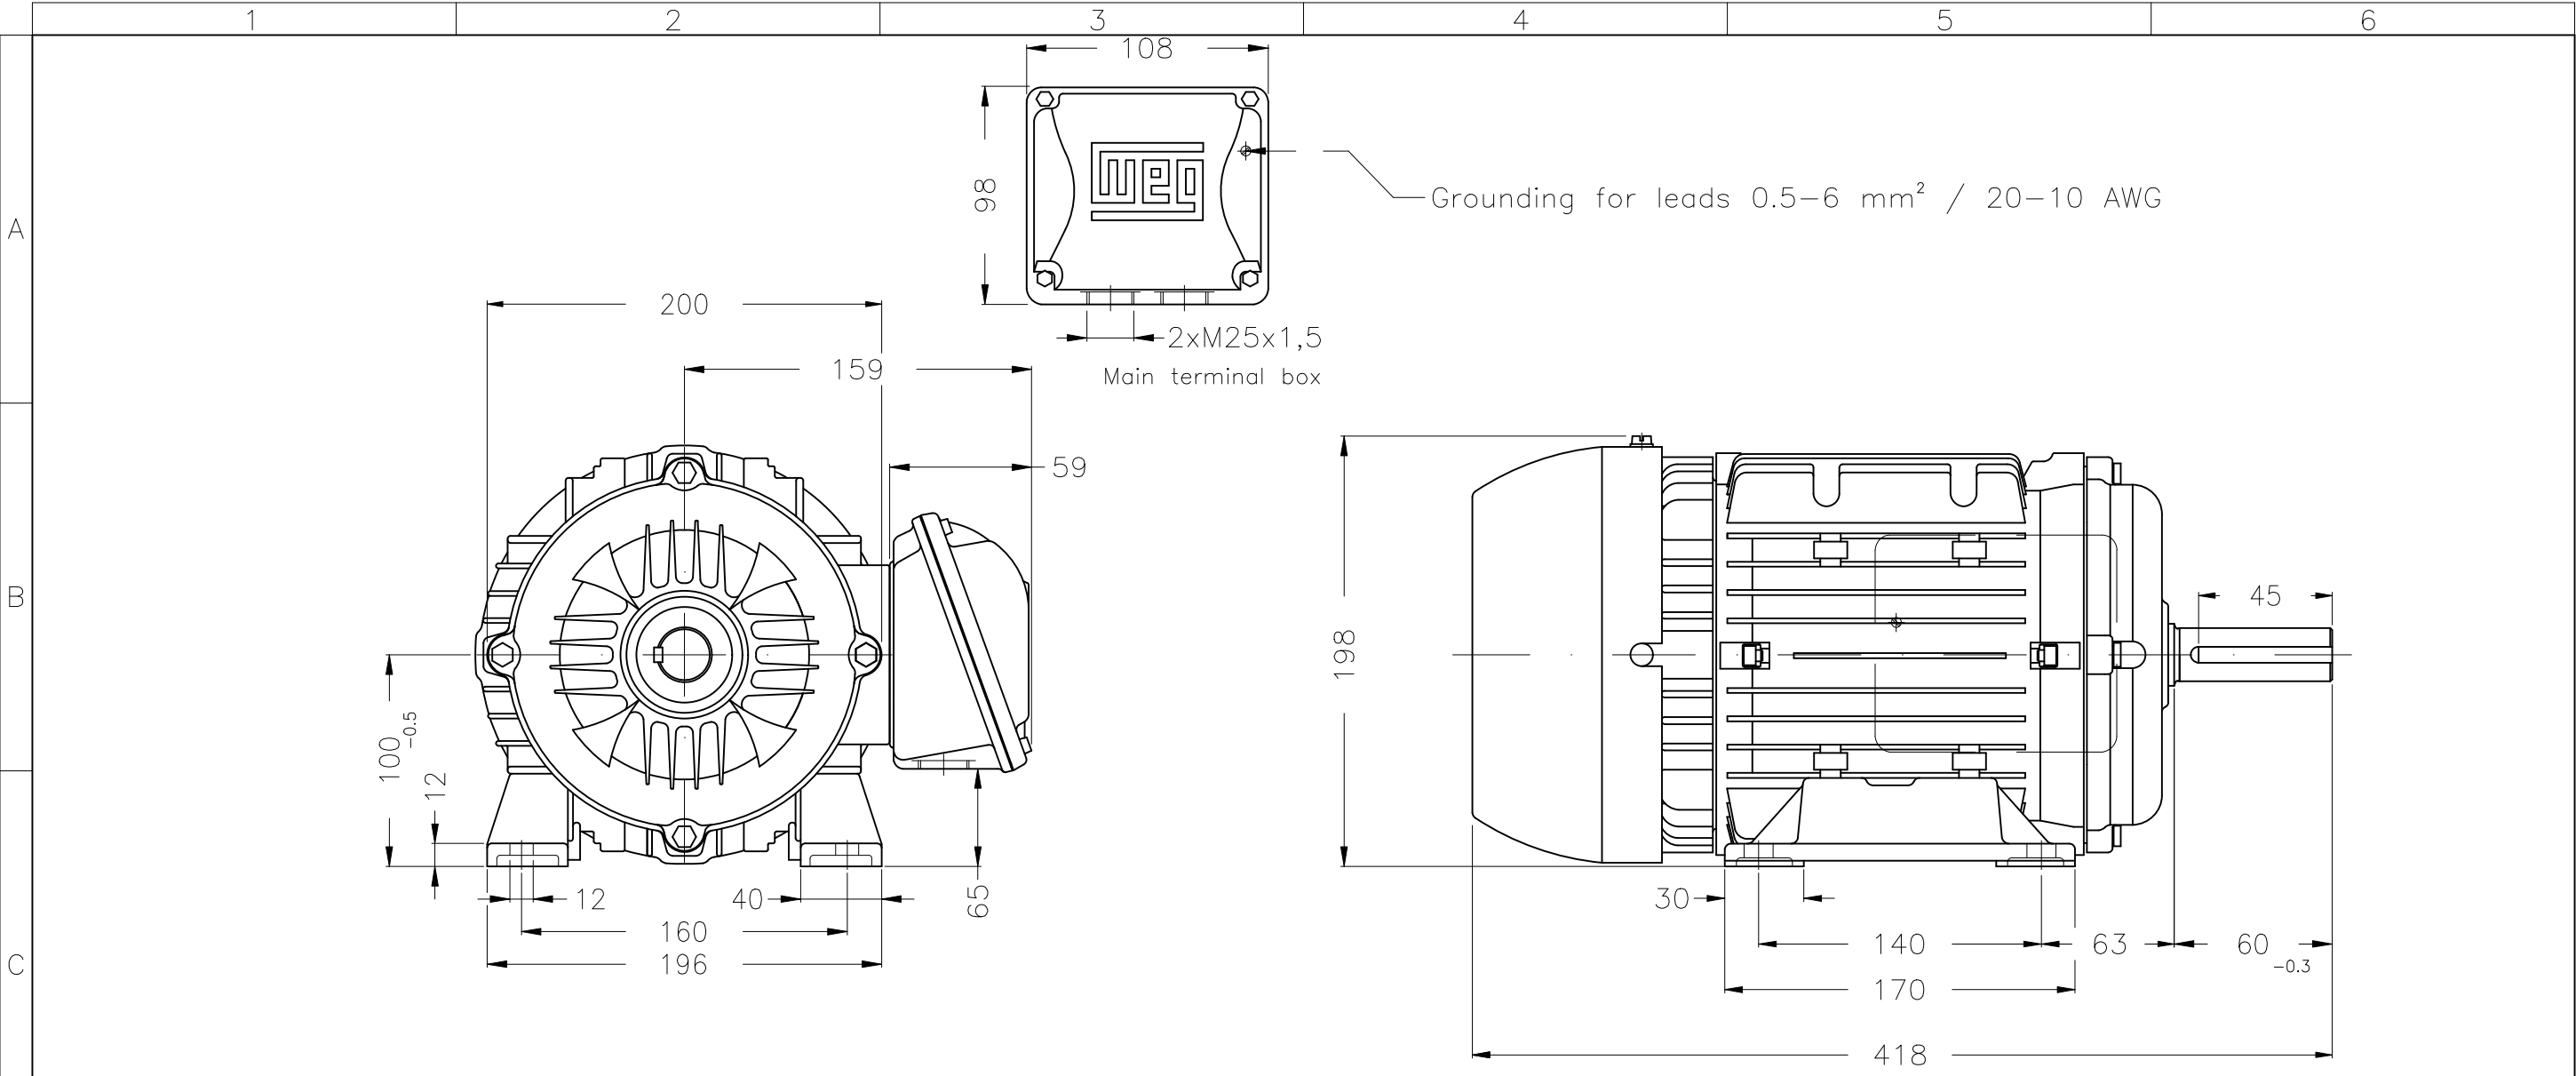
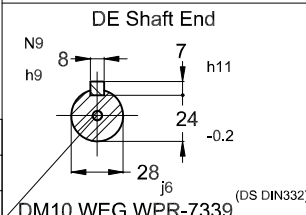




D					4 HP 04 Poles 60 Hz										A	
E										HYBRISUSER					00	
					ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER		
					EXECUTED	HYBRISUSER		THREE PH. MOTOR MULTIMOUNTIN IE3 FRAME L100L IP55 TEFC			PREVIEW WDD 00					
					CHECKED											